



UL International (Netherlands) B.V.
Westervoortsedijk 60,
6827AT Arnhem,
The Netherlands



designated according to Article 29 of the Regulation (EU) No 305/2011 and member of EOTA (European Organisation for Technical Assessment, www.eota.eu)

European Technical Assessment

ETA 24/0373
of 29/05/2024

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: **UL International (Netherlands) B.V.**

| | |
|---|--|
| Trade name of the construction product | Isover Protect Putty |
| Product family to which the construction product belongs | Fire Stopping and Sealing Product: <ul style="list-style-type: none">• Penetration Seals |
| Manufacturer | Saint-Gobain Denmark A/S: Isover A/S Østermarksvej 4, 6580 Vamdrup, Denmark |
| Manufacturing plant(s) | A/003 |
| This European Technical Assessment contains | 42 pages including 1 Annex which forms an integral part of this assessment. |
| This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of | EAD 350454-00-1104, September 2017. |

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Table of Contents

| | |
|---|-----------|
| I.SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT | 3 |
| 1 Technical description of the product | 3 |
| 2 Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350454-00-1104..... | 3 |
| 3 Performance of the product and references to the methods used for its assessment | 5 |
| 4 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD | 6 |
| 5 Issued on: | 7 |
| ANNEX A – Resistance to Fire Classification – Isover Protect Putty | 8 |
| A.1 Flexible wall constructions with wall thickness of minimum 100 mm | 8 |
| A.1.1 Pipe and cable penetration seals with 4 mm thick Isover Protect Putty in plastic socket box | 8 |
| A.1.2 Cable penetration seals with 4 mm thick Isover Protect Putty in plastic socket box | 9 |
| A.1.2.1 Double sided penetration seal with cables in socket boxes | 9 |
| A.1.3 Cable penetration seals with 4 mm thick Isover Protect Putty in metallic socket box | 10 |
| A.1.3.1 Double sided penetration seal with cables in socket boxes | 10 |
| A.1.4 Double sided penetration seal with cables | 11 |
| A.1.5 Double sided penetration seal with pipes..... | 12 |
| A.1.6 Double sided penetration seal with insulated metallic pipes, Local Interrupted (LI) | 15 |
| A.1.7 Double sided penetration seal with insulated metallic pipes, Continuous Sustained (CS)..... | 17 |
| A.2 Flexible wall constructions with wall thickness of minimum 120 mm | 20 |
| A.2.1 Cable penetration seals with 4 mm thick Isover Protect Putty in plastic socket box | 20 |
| A.2.2 Double sided penetration seal with metallic pipes | 21 |
| A.3 Rigid wall constructions with wall thickness of minimum 150 mm..... | 22 |
| A.3.1 Double sided penetration seal with insulated metallic pipes, Continuous Sustained (CS)..... | 22 |
| A.4 Rigid floor constructions with floor thickness of minimum 150 mm | 24 |
| A.4.1 Single sided penetration seal with cables | 24 |
| A.4.2 Single sided penetration seal with cables | 25 |
| A.4.3 Double sided penetration seal with cables | 26 |
| A.4.4 Single sided penetration seal with metallic pipes | 27 |
| A.4.5 Single sided penetration seal with metallic pipes | 29 |
| A.4.6 Double sided penetration seal with metallic pipes | 32 |
| A.4.7 Single sided penetration seal with insulated metallic pipes, Local Interrupted (LI) | 33 |
| A.4.8 Single sided penetration seal with insulated metallic pipes, Local Interrupted (LI) | 35 |
| A.4.9 Single sided penetration seal with insulated metallic pipes, Continuous Sustained (CS) | 37 |
| A.4.10 Single sided penetration seal with insulated metallic pipes, Continuous Sustained (CS) | 40 |
| ANNEX B – Air Permeability – Isover Protect Putty..... | 42 |

I. SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT

1 Technical description of the product

- 1) Isover Protect Putty is a flexible pad or cord used to reinstate the fire resistance performance of wall and floor constructions where they have been provided with apertures for the penetration of insulated or uninsulated metallic pipes, cables, and pipes or cables into socket boxes.
- 2) The Isover Protect Putty is supplied precut to size with a peel off strip to both faces to prevent it from bonding materials other than for the desired application. The Isover Protect Putty is installed by removing the peelable strips and wrapping the pad around the socket box where it penetrates the face of the wall and covering the back face of the box. When installing around service penetrations, the Isover Protect Putty is installed by removing the peelable strips and wrapping the cord around the service where it penetrates the face of the wall or floor.
- 3) The applicant has submitted a written declaration that Isover Protect Putty does not contain substances which have to be classified as dangerous according to Directive 67/548/EEC and Regulation (EC) No 1272/2008 and listed in the "Indicative list on dangerous substances" of the EGDS - taking into account the installation conditions of the construction product and the release scenarios resulting from there.

In addition to the specific clauses relating to dangerous substances contained in this European technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g., transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

- 4) The use category of Isover Protect Putty in relation to BWR 3 (Hygiene, health and environment) is IA1.

2 Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350454-00-1104

Detailed information and data is given in Annex A.

- 1) The intended use of Isover Protect Putty is to reinstate the fire resistance performance of flexible, masonry or concrete walls and rigid floor constructions where they are penetrated by insulated or uninsulated metallic pipes, cables and the pipe or cable protrusion of socket boxes.
- 2) The specific elements of construction that the system Isover Protect Putty may be used to provide a penetration seal in, are as follows:
 - a. Flexible walls: The wall must have a minimum thickness of 100 mm and comprise steel studs or timber studs* lined on both faces with minimum 2 layers of 12.5 mm thick boards.
 - b. Rigid walls: The wall must have a minimum thickness of 100 mm and comprise concrete, aerated concrete or masonry with a minimum density of 650 kg/m³.
 - c. Rigid floors: The floor must have a minimum thickness of 150 mm and comprise aerated concrete or concrete with a minimum density of 650 kg/m³.

* no part of the penetration seal may be closer than 100 mm to a stud, the cavity must be closed between the penetration seal and the stud, and minimum 100 mm of insulation of class A1 or A2 according to EN 13501-1 must be provided within the cavity between the penetration seal and the stud.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

Saint-Gobain Denmark A/S: Isover A/S Fire Protection Systems which involve seals on both sides of a flexible wall may also be used in the situation where the linear seal is on one side of the wall only and the remaining side of the wall is not punctured at the same point. All fire integrity and thermal insulation ratings for such single-sided seals remain the same as for the equivalent double-sided seal.

- 3) The System Isover Protect Putty may be used to provide a penetration seal for insulated or uninsulated metallic pipes, cables and the pipe or cable protrusion of socket boxes (for details see Annex A).
- 4) The system Isover Protect Putty may be used to seal gaps between 0 mm and 10 mm surrounding cables, cable bundles, non-insulated and insulated pipes, and 137 mm wide by 77 mm high (aperture containing socket box) and be installed in accordance with the manufacturer's instructions. When used with socket boxes, the aperture in the wall shall be as tight as possible to the penetration pipe or cable and any gaps filled with plaster filler or Isover Protect Acrylic.
- 5) Where single sided top face seals are described in Annex A, these can also be used in composite floors (e.g., Concrete filled, steel trapezoidal decking).
- 6) Services shall be supported at maximum 300 mm away from both faces of the wall constructions, and 500 mm from the upper face of floor constructions.
- 7) The designation U/U, C/U, U/C or C/C indicates whether or not the product under test is sealed during the fire test.

The first letter refers to the situation in the oven and the second to the situation outside the oven (see table).

| Test Condition | Configuration | |
|----------------|--|---|
| | Exposed to heat from oven (inside the oven) | Unexposed to heat from oven (outside the oven) |
| U/U | Unsealed | Unsealed |
| C/U | Sealed | Unsealed |
| U/C | Unsealed | Sealed |
| C/C | Sealed | Sealed |

- a. The tests carried out with unsealed ends (U/U) correspond to the most unfavorable situation, since the fire can spread more easily because the two ends are unsealed. The results of these tests may therefore be applied in all situations (U/U, C/U, U/C and C/C).
 - b. The C/U tests may be used in the following situations: C/U, U/C and C/C.
 - c. The U/C tests may in turn be used for situations U/C and C/C, while the C/C tests may only be used in the C/C situation.
- 8) The provisions made in this European Technical Assessment are based on an assumed working life of the Isover Protect Putty of 25 years, provided that the conditions laid down in the product datasheet for the packaging/transport/ storage/installation/use/repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.
 - 9) Type Z₂: Intended for uses in internal conditions with humidity lower than 85 % RH excluding temperatures below 0°C, without exposure to rain or UV.

3 **Performance of the product and references to the methods used for its assessment**

| Product-type: Intumescent sheet | | Intended use: Penetration Seal |
|--|--|---|
| Assessment method | Essential characteristic | Product performance |
| BWR 2 Safety in case of fire | | |
| EN 13501-1 | Reaction to fire | No performance determined |
| EN 13501-2 | Resistance to fire | Annex A |
| BWR 3 Hygiene, health and environment | | |
| EN 1026 | Air permeability | Annex B |
| EAD 350454-00-1104, Annex C | Water permeability | No performance determined |
| Declaration of manufacturer & EN 16516 | Content, emission and/or release of dangerous substances | Use categories: IA1 Declaration of manufacturer |
| BWR 4 Safety in use | | |
| EOTA TR 001:2003 | Mechanical resistance and stability | No performance determined |
| EOTA TR 001:2003 | Resistance to impact/movement | No performance determined |
| EOTA TR 001:2003 | Adhesion | No performance determined |
| EAD 350454-00-1104, Clause 2.2.9 | Durability | Z ₂ |
| BWR 5 Protection against noise | | |
| EN 10140-1,2,4,5/ EN ISO 717-1 | Airborne sound insulation | R _w (C;C _{tr})= 67 (-2;-7) dB* |
| BWR 6 Energy economy and heat retention | | |
| EN 12664, EN 12667, EN 12939, EN ISO 8990, EN ISO 6946, EN ISO 14683, EN ISO 10211, EN ISO 10456 | Thermal properties | No performance determined |
| EN ISO 12572, EN 12086, EN ISO 10456 | Water vapour permeability | No performance determined |

*Applicable only for Isover Protect Putty Pads in socket boxes

ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE

According to the decision 1999/454/EC – Commission Decision of date 22nd June 1999 on the procedure for attesting the conformity of construction products pursuant to Article 20(2) of Council Directive 89/106/EEC as regards fire stopping, fire sealing and fire protective products, published in the Official Journal of the European Union (OJEU) L178/52 of 14/07/1999, (see <https://eur-lex.europa.eu/oj/direct-access.html>) of the European Commission¹, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table(s) applies (apply).

| Product(s) | Intended use(s) | Level(s) or class(es) | System(s) |
|---|--|-----------------------|-----------|
| Fire stopping and Fire Sealing Products | For fire compartmentation and/or fire protection or fire performance | Any | 1 |

4 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Tasks of the manufacturer:

Factory production control

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall ensure that the product is in conformity with this European technical Assessment.

The manufacturer may only use initial / raw / constituent materials stated in the technical documentation of this European Technical Assessment.

The factory production control shall be in accordance with the Control Plan of 7th February 2023 relating to the European technical assessment ETA 24/0373 issued on 29/05/2024 which is part of the technical documentation of this European technical Assessment. The "Control Plan" is laid down in the context of the factory production control system operated by the manufacturer and deposited at UL International (Netherlands) B.V.

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the Control Plan.

¹ Official Journal of the European Communities L178/52 of 14/7/1999

Other tasks of the manufacturer:

Additional information

The manufacturer shall provide a technical data sheet and an installation instruction with the following minimum information:

(a) Technical data sheet:

- Field of application:
- Building elements for which the penetration seal is suitable, type and properties of the building elements like minimum thickness, density, and - in case of lightweight constructions – the construction requirements.
- Limits in size, minimum thickness etc. of the penetration seal
- Construction of the penetration seal including the necessary components and additional products (e.g. backfilling material) with clear indication whether they are generic or specific.
- Services which the penetration seal is suitable, type and properties of the services like material, diameter, thickness etc. in case of pipes including insulation materials; necessary/allowed supports/fixings (e.g. pipe trays)

(b) Installation instruction:

- Steps to be followed
- Procedure in case of retrofitting
- Stipulations on maintenance, repair and replacement

5 Issued on:

29 May 2024

Report by:



D. Yates
Staff Engineer
Built Environment

Verified by:



C. Johnson
Senior Staff Engineer
Built Environment

Validated by:



Erik Teubler
Head of TAB
Built Environment

For and on behalf of UL International (Netherlands) B.V.


ANNEX A – Resistance to Fire Classification – Isover Protect Putty

A.1 Flexible wall constructions with wall thickness of minimum 100 mm

A.1.1 Pipe and cable penetration seals with 4 mm thick Isover Protect Putty in plastic socket box

Penetration Seal: Socket boxes placed back-to-back or side-by-side with zero distance, or further apart protected with Isover Protect Putty pads. The socket boxes can be fixed directly to drywall studs, or to timber noggins or steel plates fixed to studs.

Construction details:

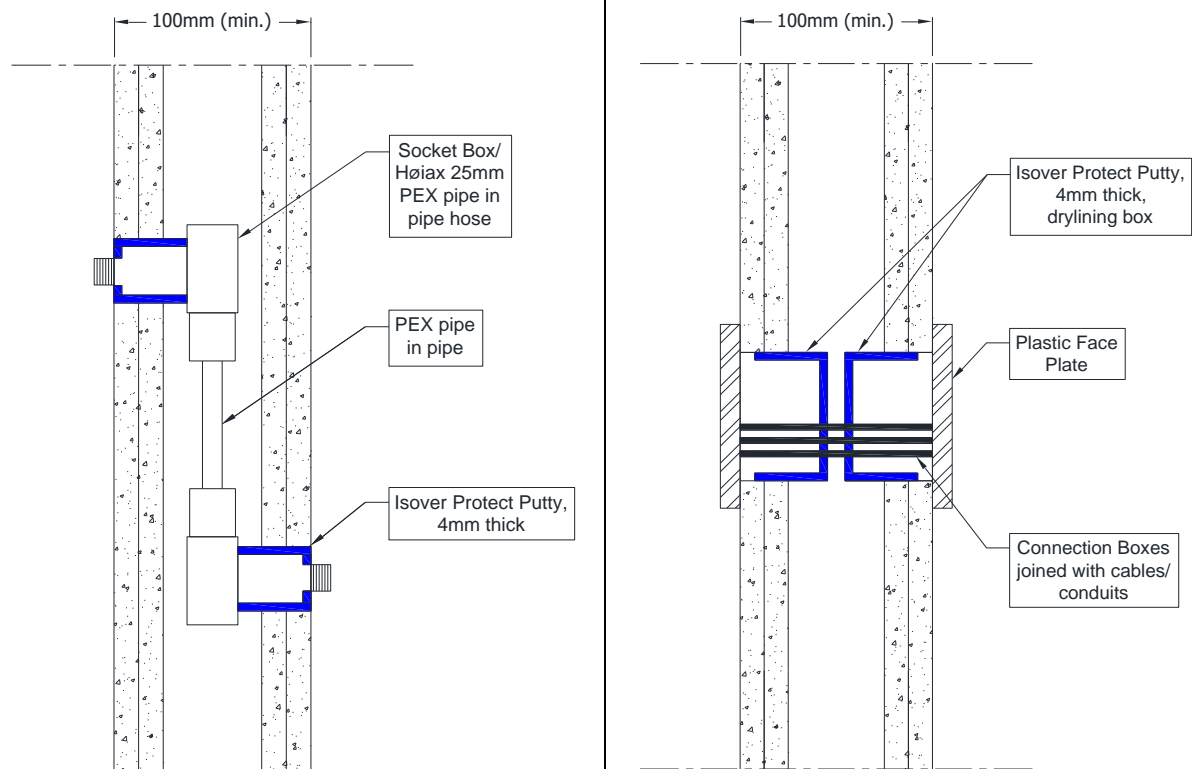


A.1.1.1 Double side penetration seal with pipes or cables in socket boxes

| Services | Socket box | Isover Protect Putty - mm | Aperture mm | Classification |
|----------------------------------|---|---|----------------------------|----------------|
| Høiax 25mm PEX pipe in pipe hose | Single or double Høiax Push Wallbox 15mm, fitted side-by-side | 174 x 64 x 4 mm pad around pipe / 50 Ø x 25 mm at back of the box | 63 Ø | EI 90 |
| Cables up to 14 mm diameter | Plastic UK standard double socket box, maximum 130mm wide x 70mm high x 47mm deep, each with up to 22mm hole cut to accept the cables | Interior of box fully lined with pad | Maximum 135 wide x 75 high | EI 60 |

A.1.2 Cable penetration seals with 4 mm thick Isover Protect Putty in plastic socket box

Penetration Seal: Plastic socket boxes placed side-by-side with zero distance, or further apart protected with Isover Protect Putty pads. The socket boxes can be fixed directly to drywall studs, or to timber noggins or steel plates fixed to studs.

Construction details:

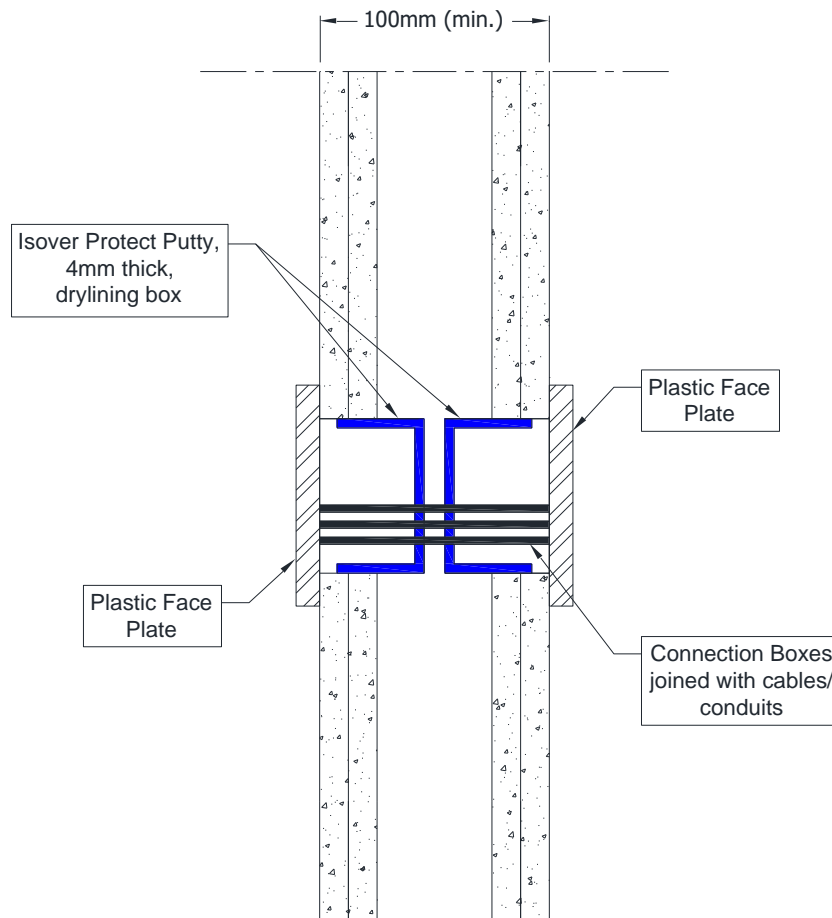


A.1.2.1 Double sided penetration seal with cables in socket boxes

| Services | Socket box | Isover Protect Putty | Aperture mm | Classification |
|-----------------------------|---|--|-----------------------------|--------------------|
| Cables up to 14 mm diameter | Schneider Electric Ref. IMT 36026 connection box, 72mm wide x 90mm high x 50mm deep | Fitted lining the back of the back box | 73 wide x 91 High x 51 deep | E 60, EI 45 |
| Cables up to 14 mm diameter | Elko 4189 1223720 connection box, 72mm wide x 90mm high x 58mm deep | Interior of box fully lined with pad | 92 wide x 112 High | EI 90 |
| Cables up to 14 mm diameter | ELKO 5421 123740 connection box, 73mm wide x 73mm high x 55mm deep | Interior of box fully lined with pad | 74 wide x 74 High | EI 90 |

A.1.3 Cable penetration seals with 4 mm thick Isover Protect Putty in metallic socket box

Penetration Seal: Metallic socket boxes placed back-to-back or side-by-side with zero distance, or further apart protected with Isover Protect Putty pads. The socket boxes can be fixed directly to drywall studs, or to timber noggins or steel plates fixed to studs.

Construction details:

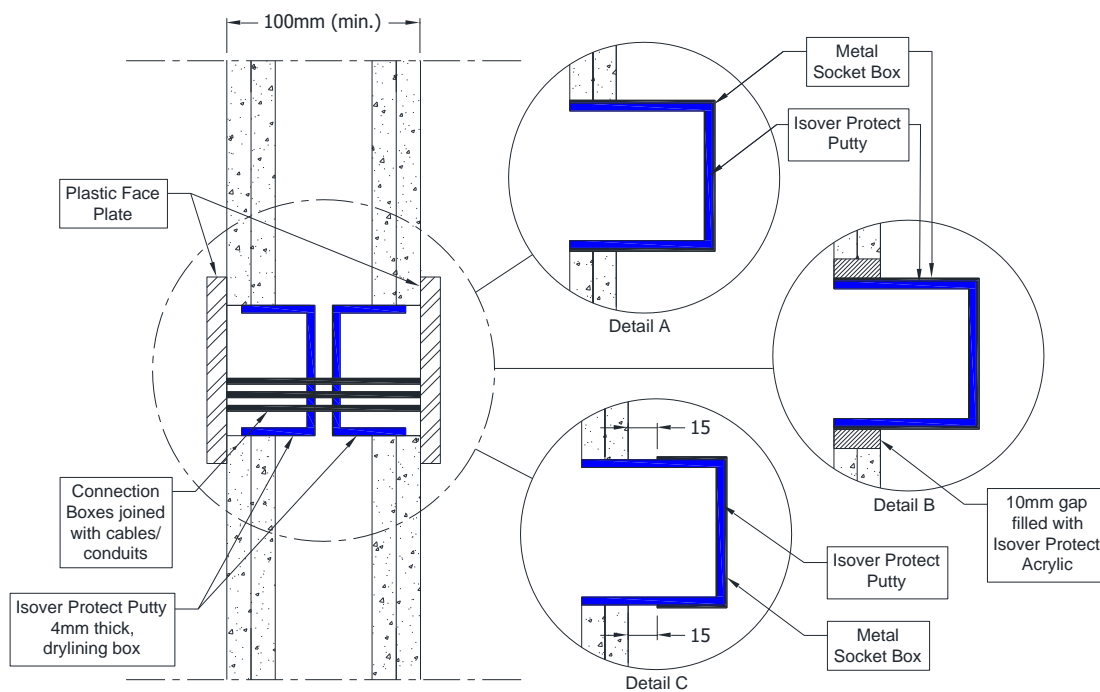


A.1.3.1 Double sided penetration seal with cables in socket boxes

| Services | Steel standard UK double socket box with plastic socket cover | Isover Protect Putty pad | Detail drawing | Aperture mm (max) | Classification |
|-----------------------------|--|--|----------------|-------------------|----------------|
| Cables up to 14 mm diameter | Max. 134 mm wide x 74 mm high x 47 mm deep | Interior of box fully lined | A | 134 x 74 | E 90 EI 60 |
| Cables up to 14 mm diameter | Max. 134 mm wide x 74 mm high x 47 mm deep with 25 mm metal extension box, fitted side-by-side | Interior of box fully lined | A | 134 x 74 | E 120 EI 60 |
| Cables up to 14 mm diameter | Max. 134 mm wide x 74 mm high x 47 mm deep, fitted side-by-side, with max. 10 mm gap to plaster boards sealed with min. 12.5mm deep Isover Protect Acrylic | Interior of box fully lined | B | 154 x 94 | E 120 EI 90 |
| Cables up to 14 mm diameter | Max. 134 mm wide x 74 mm high x 35 mm deep, fitted side-by-side, recessed with a max. 15 mm air gap between back box and plasterboard | Interior of box, air gap and plaster board fully lined | C | 134 x 74 | EI 90 |

A.1.4 Double sided penetration seal with cables

Penetration Seal: Cables (single or bundled up to 50 mm Ø) penetrating through a flexible or rigid wall construction and fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on both sides of the wall. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

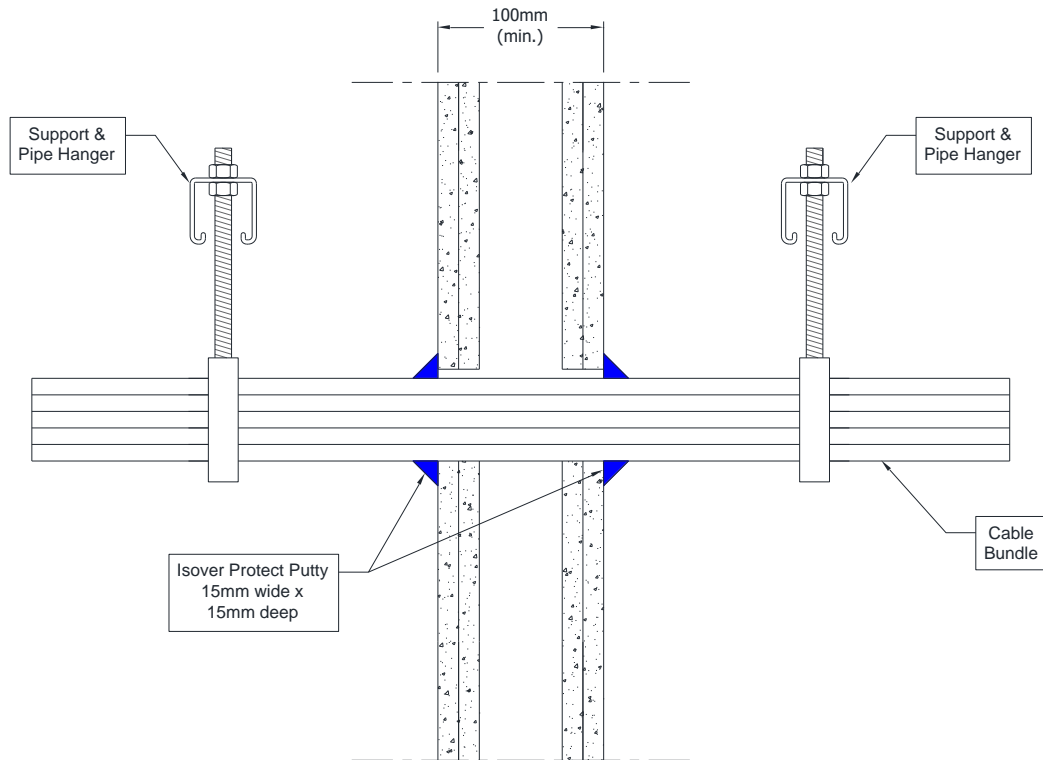

A.1.4.1


| Services | Classification |
|---|----------------|
| Blank seal with a 15 mm deep cord of Isover Protect Putty on both sides of the wall | EI 120 |
| Cables up to 21 mm diameter, single or in a bundle up to 50 mm diameter* | EI 120 |
| Cables up to 80 mm diameter, single or in a bundle up to 50 mm diameter* | EI 60 |

* Cable specification from EN 1366-3 standard cable configuration

A.1.5 Double sided penetration seal with pipes

Penetration Seal: Pipes penetrating through a flexible or rigid wall construction and fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on both sides of the wall. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

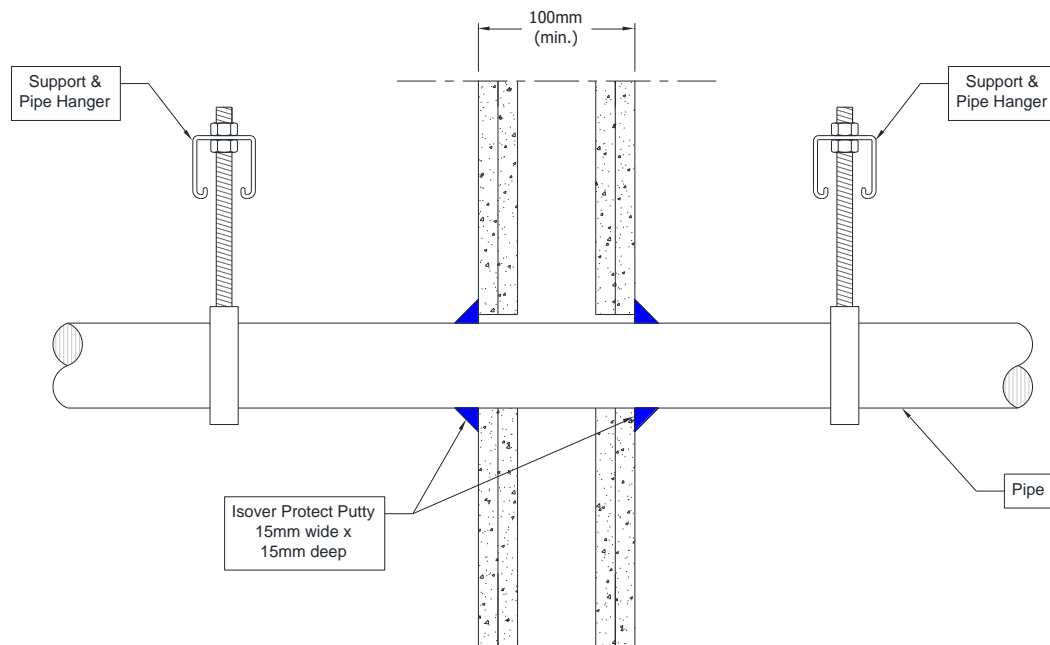


A.1.5.1


| Services | Insulation | Classification |
|---|-------------|------------------|
| Mild or stainless steel pipe | | |
| Maximum 22 mm diameter* | None needed | EI 120 C/U |
| 23-30 mm diameter* | None needed | E 120, EI 45 C/U |
| ALUPEX pipe | | |
| 16 mm diameter* | None needed | EI 120 C/C |
| 17-20 mm diameter* | None needed | E 120, EI 90 C/C |
| Copper or steel pipe | | |
| 6 mm diameter* | None needed | EI 120 C/C |
| 7-12 mm diameter* | None needed | E 120, EI 60 C/C |
| PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1 and PVC-C according to EN 1566-1 | | |
| PVC plastic pipe at maximum 25 mm diameter with 1.5 mm pipe wall thickness | None needed | EI 60 U/C |

*See below graphs for interpolation pipe sizes


Mild or Stainless Steel Pipes - EI 120 C/C

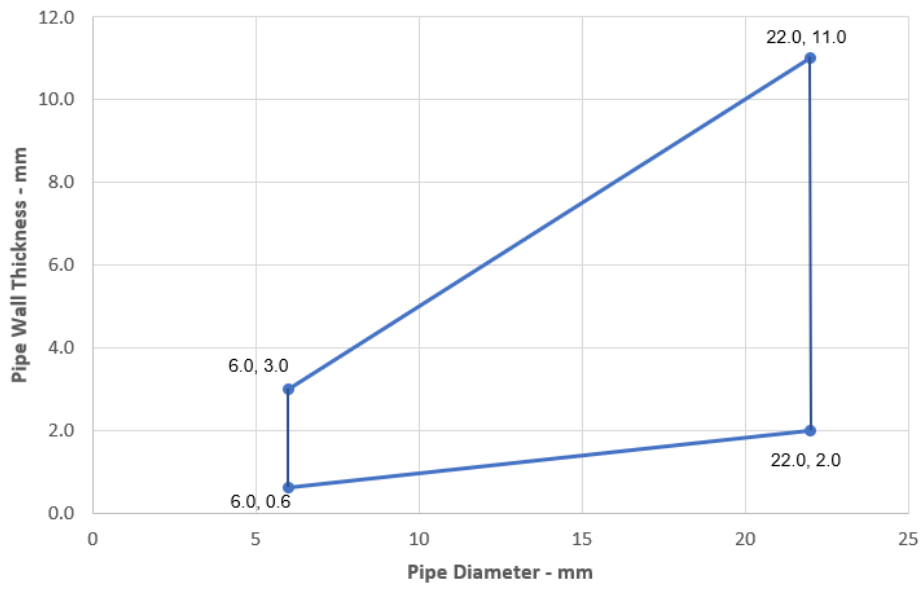


Steel Pipes - E 120, EI 45 C/U

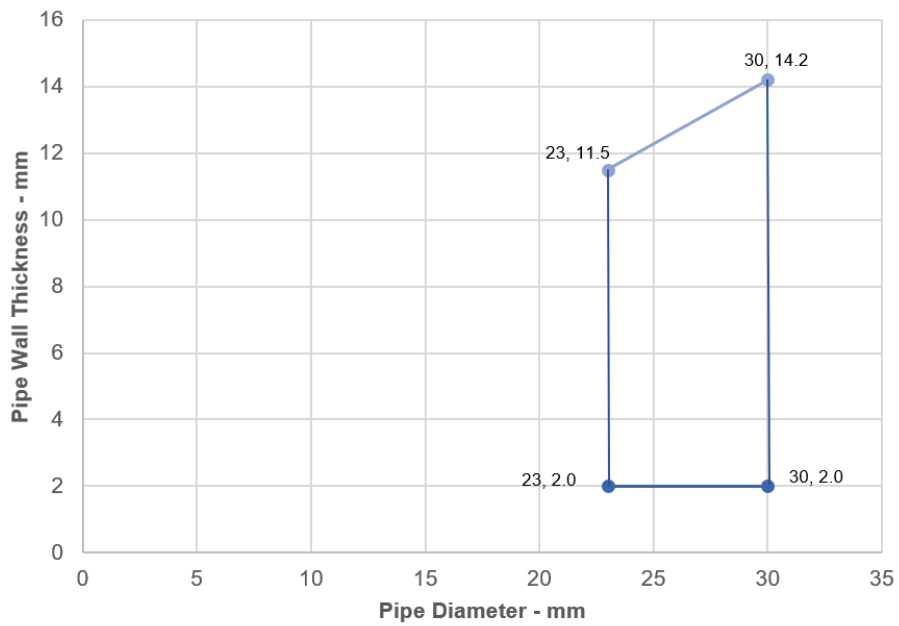

ALUPEX Pipes - E 120, EI 90 C/C

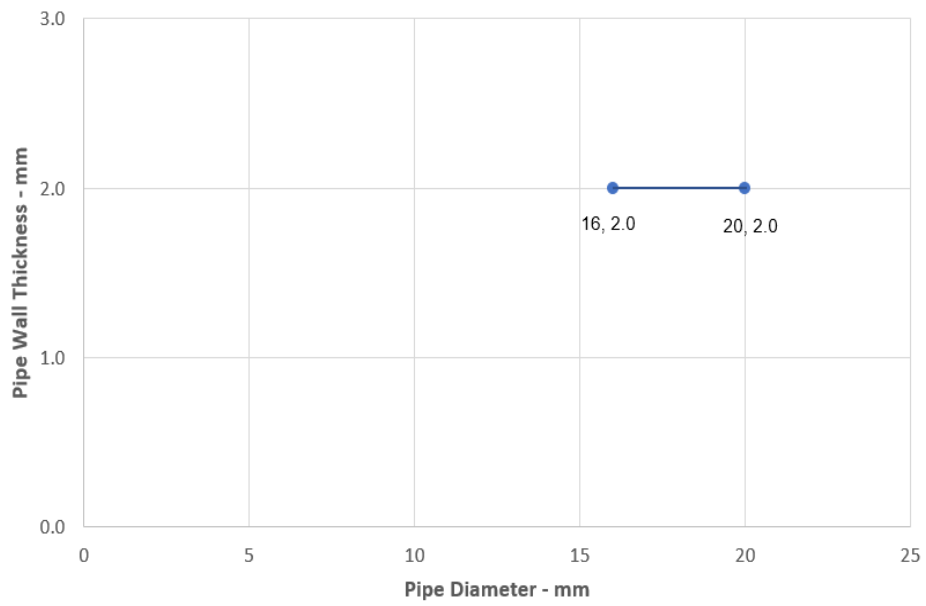


Copper Pipes- E120, EI 60 C/C

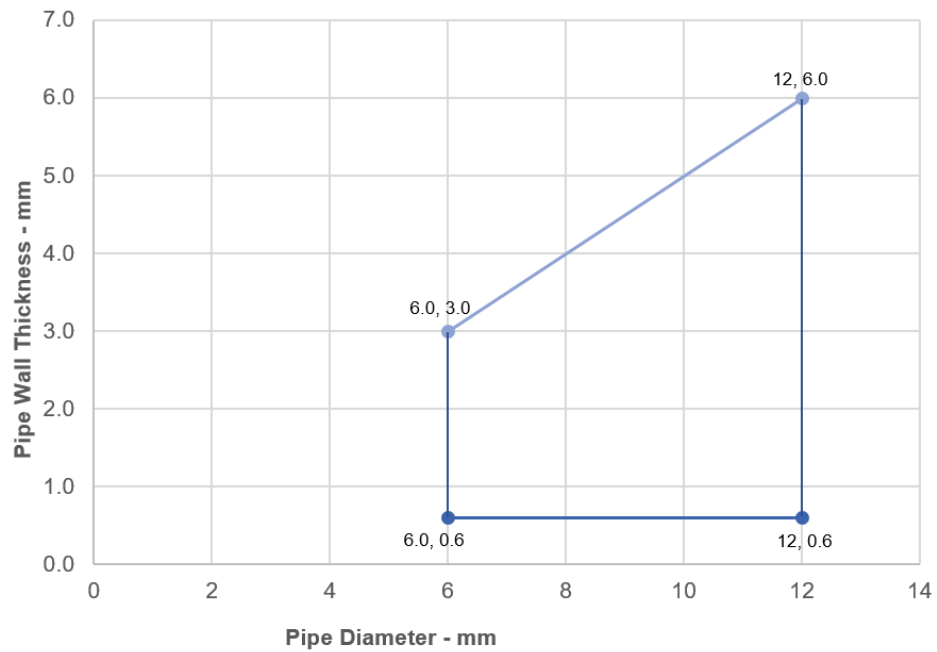

A.1.6 Double sided penetration seal with insulated metallic pipes, Local Interrupted (LI)

Penetration Seal: Metallic pipes insulated with minimum 80 kg/m³ density mineral wool insulation, Local Interrupted (LI), penetrating through a flexible or rigid wall construction, fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on both sides of the wall. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).



Construction details:

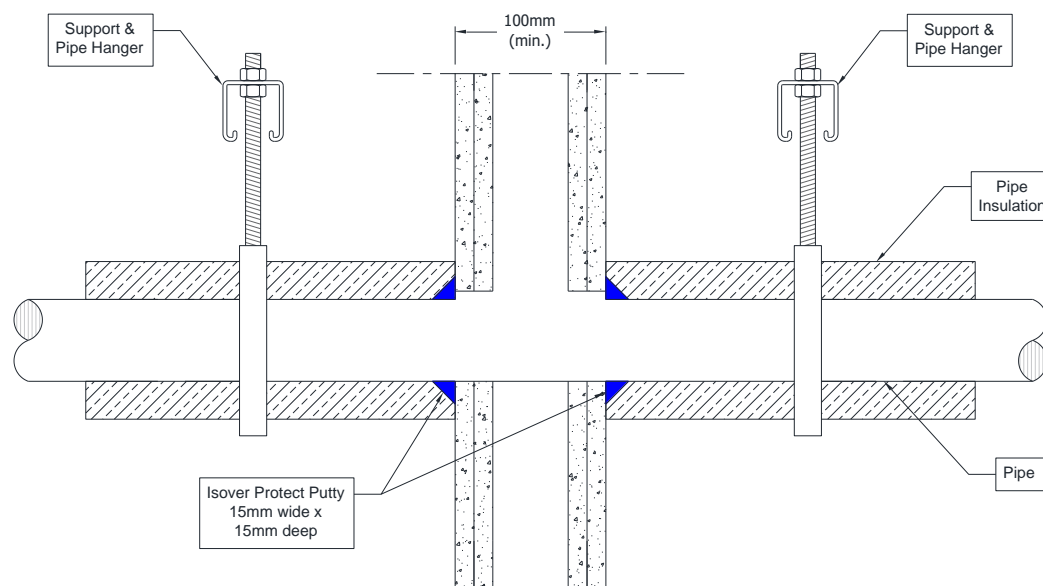

A.1.6.1

| Services | Insulation | Classification |
|---|---|-----------------|
| Mild or stainless steel pipe, with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 40 mm diameter* | Minimum 20 mm thick insulation, 500 mm long butted up to the wall on both faces | EI 120 C/U |
| 40-324 mm diameter* | Minimum 30 mm thick insulation, 500 mm long butted up to the wall on both faces | EI 120 C/U |
| Copper or steel pipe with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 54 mm diameter/1.2-14.2 mm wall | Minimum 20 mm thick insulation, 500 mm long butted up to the wall on both faces | E 90, EI 60 C/C |
| ALUPEX pipe with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 16 mm diameter* | Minimum 20 mm thick insulation, 500 mm long butted up to the wall on both faces | EI 90 C/C |
| Maximum 75 mm diameter* | Minimum 30 mm thick insulation, 500 mm long butted up to the wall on both faces | EI 90 C/C |


*See below graphs for interpolation pipe sizes

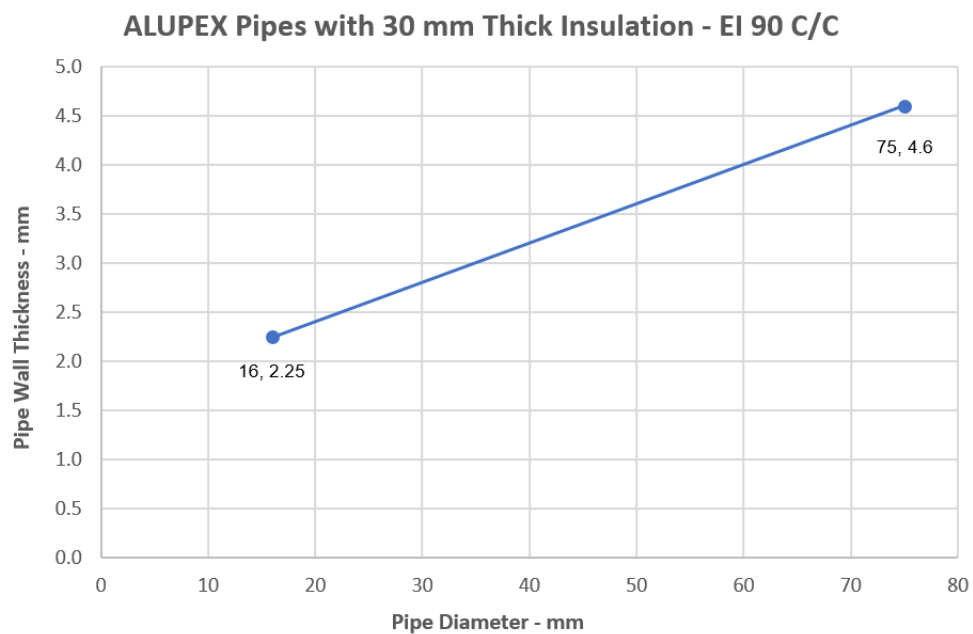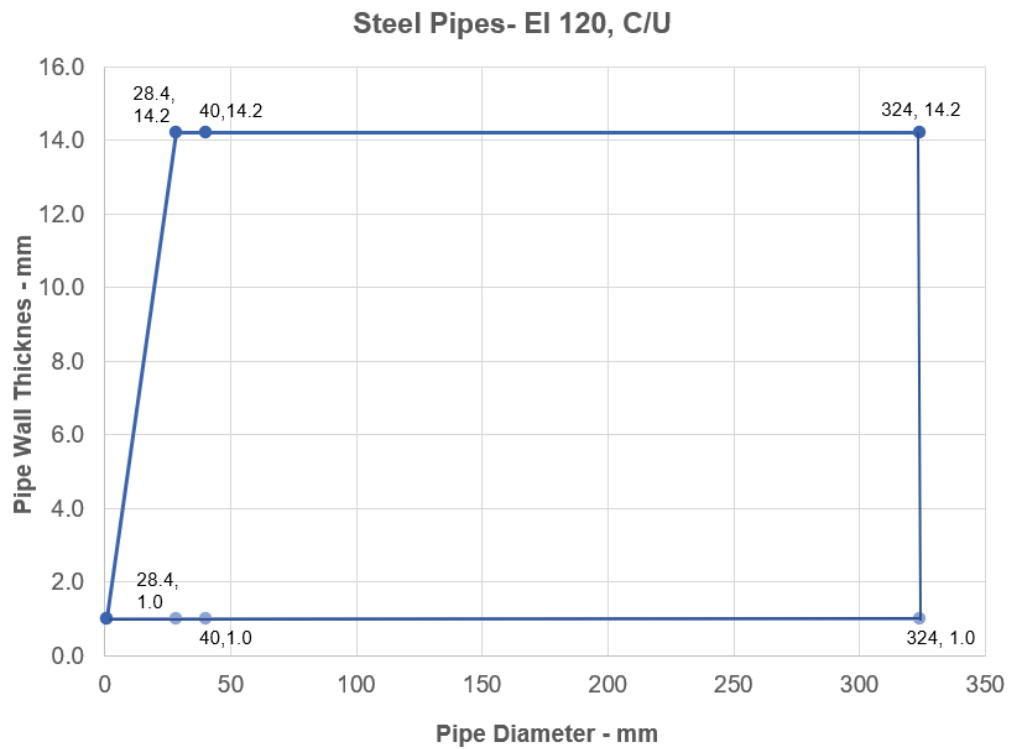

A.1.7 Double sided penetration seal with insulated metallic pipes, Continuous Sustained (CS)

Penetration Seal: Metallic pipes insulated with minimum 80 kg/m³ density mineral wool insulation, Continuous Sustained (CS), penetrating through a flexible or rigid wall construction, fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on both sides of the wall. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

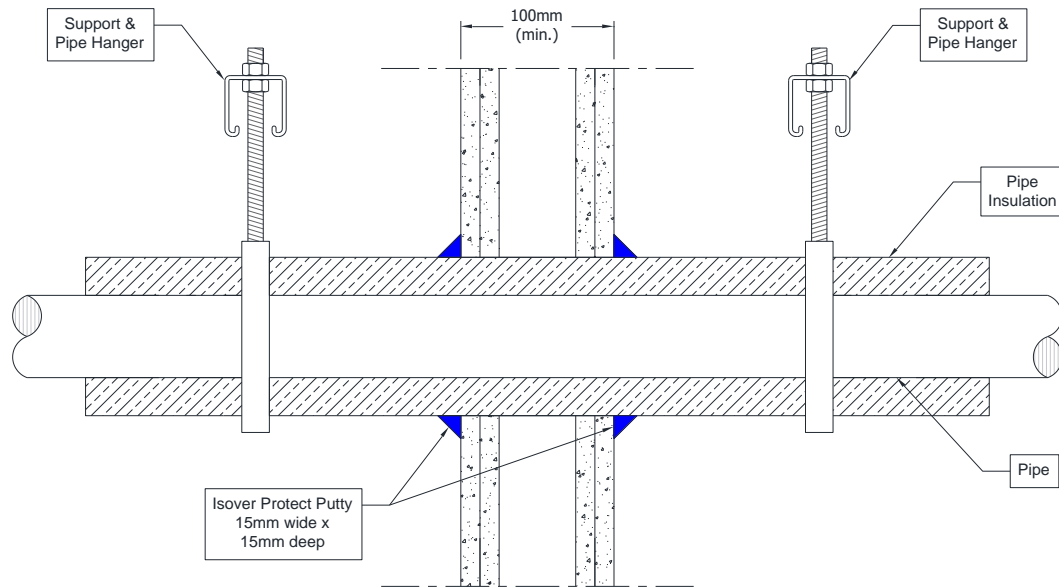


A.1.7.1


| Services | Insulation | Classification |
|---|----------------|-----------------|
| Mild or stainless steel pipe, with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 40 mm diameter* | 20 mm thick | EI 120 C/U |
| 40-324 mm diameter* | 30-80 mm thick | E 90, EI 60 C/U |
| Copper or steel pipe with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 12 mm diameter/0.7-6.0 mm wall* | 20 mm thick | E90, EI 60 C/C |
| Maximum 54 mm diameter/1.2-14.2 mm wall, | 30-80 mm thick | E 90, EI 60 C/C |
| ALUPEX pipe with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 16 mm diameter* | 20 mm thick | EI 90 C/C |
| Maximum 75 mm diameter* | 30-80 mm thick | EI 90 C/C |

*See below graphs for interpolation pipe sizes


Steel Pipes- E 90, EI 60, C/U

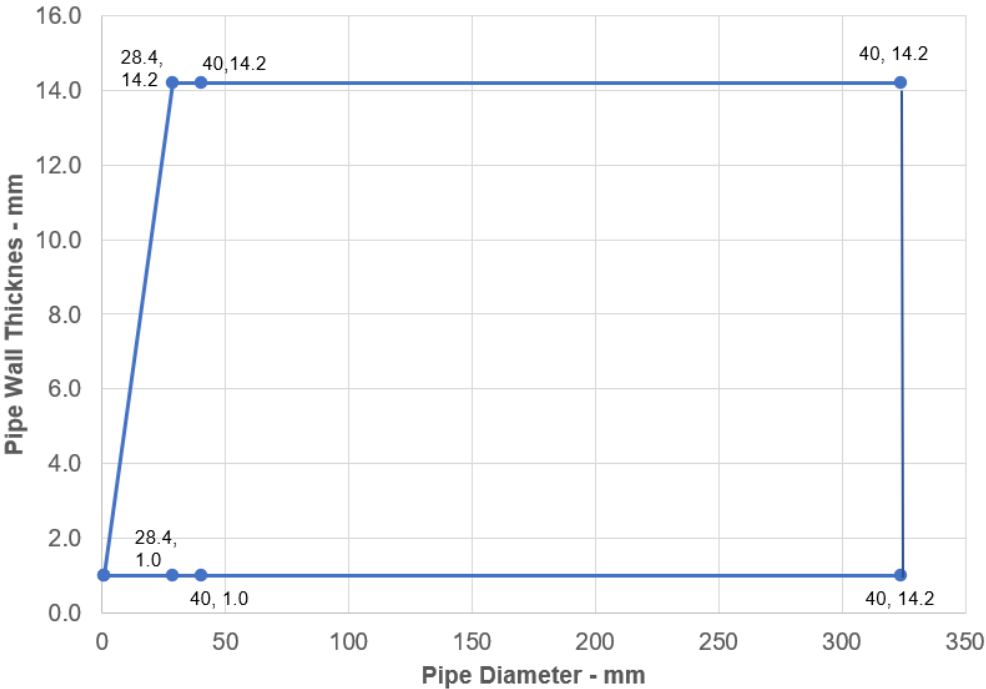

Copper or Steel Pipes with 30-80 mm Thick Insulation - E 90, EI 60, C/C

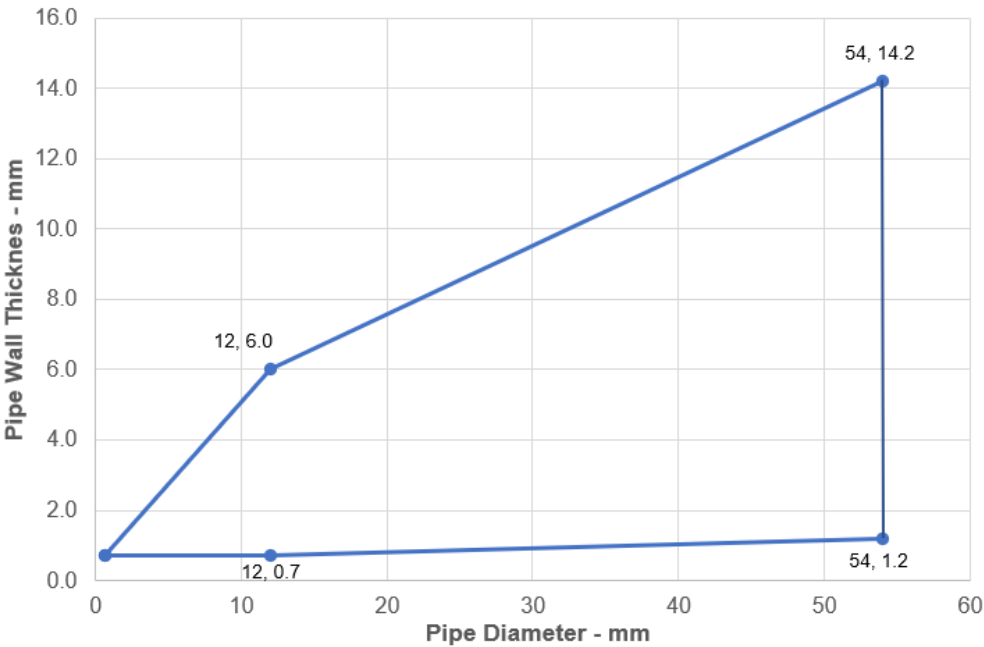

ALUPEX Pipes with 30-80 mm Thick Insulation - EI 90 C/C

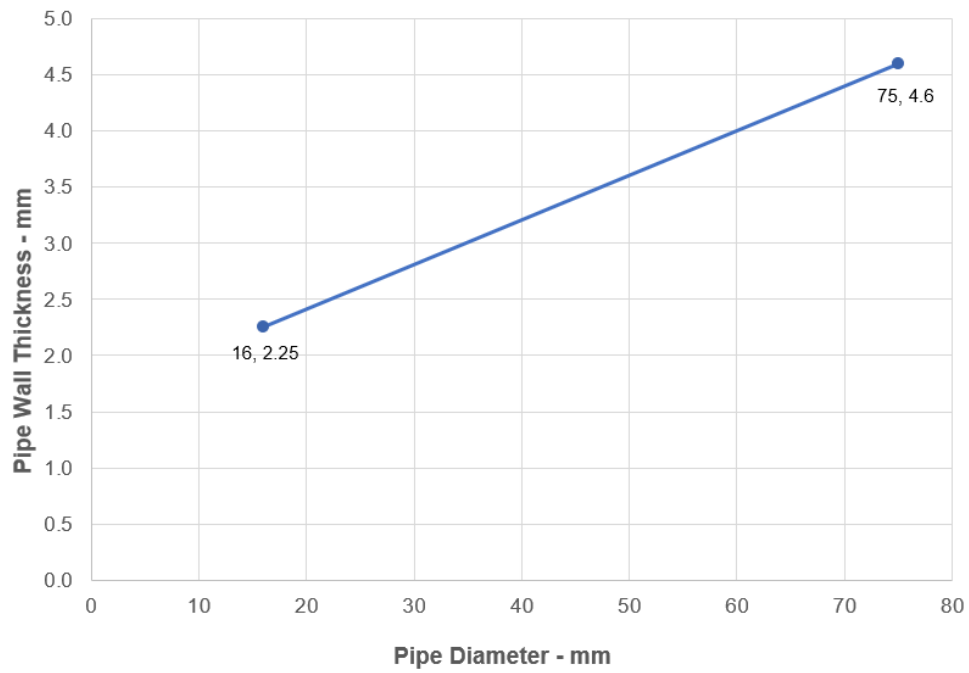


A.2 Flexible wall constructions with wall thickness of minimum 120 mm

A.2.1 Cable penetration seals with 4 mm thick Isover Protect Putty in plastic socket box

Penetration Seal: Socket boxes placed back-to-back or side-by-side with zero distance, or further apart protected with Isover Protect Putty pads. The socket boxes can be fixed directly to drywall studs, or to timber noggins or steel plates fixed to studs.

Construction details:

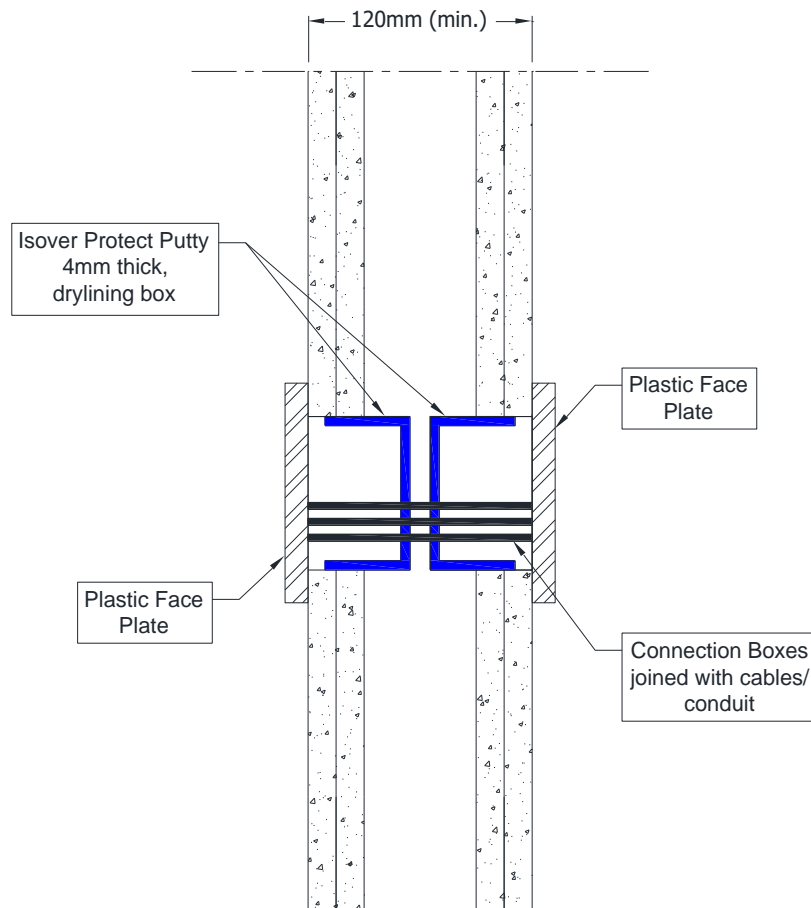


A.2.1.1 Double side penetration seal with cables in plastic socket boxes

| Services | Socket box | Isover Protect Putty | Aperture mm | Classification |
|------------------------------|---|--------------------------------------|----------------------------|----------------|
| Cables up to 14 mm diameter | UK standard double socket box, maximum 130mm wide x 70mm high x 48mm deep, each with a 25mm wide x 14mm high knock out section to accept the cables | Interior of box fully lined with pad | Maximum 135 wide x 72 High | EI 120 |
| 2.5 mm twin and earth cables | | | | |

A.2.2 Double sided penetration seal with metallic pipes

Penetration Seal: Metallic pipes penetrating through a flexible or rigid wall construction and fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on both sides of the wall. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

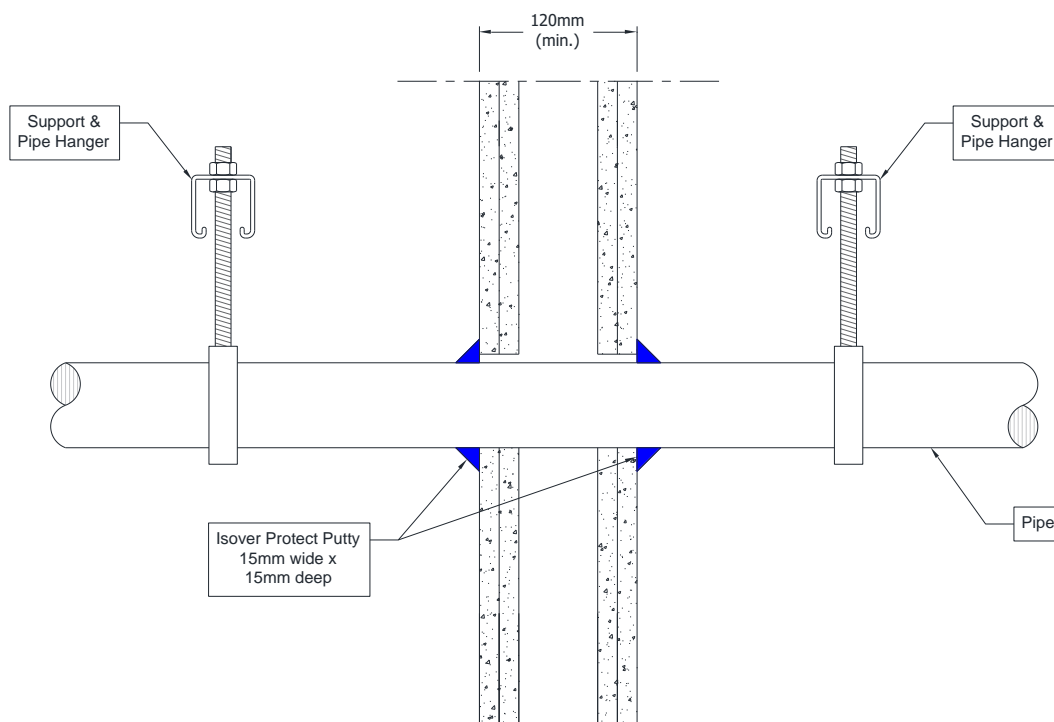

A.2.2.1


| Services | Insulation | Classification |
|---|-------------|-----------------|
| Mild or stainless steel pipe | | |
| Maximum 324 mm diameter/6.35-14.2 mm wall | None needed | E 90, EI 20 C/U |
| ALUPEX pipe | | |
| Maximum 75 mm diameter/4.6-14.2 mm wall | None needed | EI 90 C/C |
| Copper or steel pipe | | |
| Maximum 54 mm diameter/1.2-14.2 mm wall | None needed | E 90, EI 15 C/C |

A.3 Rigid wall constructions with wall thickness of minimum 150 mm

A.3.1 Double sided penetration seal with insulated metallic pipes, Continuous Sustained (CS)

Penetration Seal: Metallic pipes insulated with minimum 80 kg/m³ density mineral wool insulation, Continuous Sustained (CS), penetrating through a rigid wall construction, fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on both sides of the wall. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

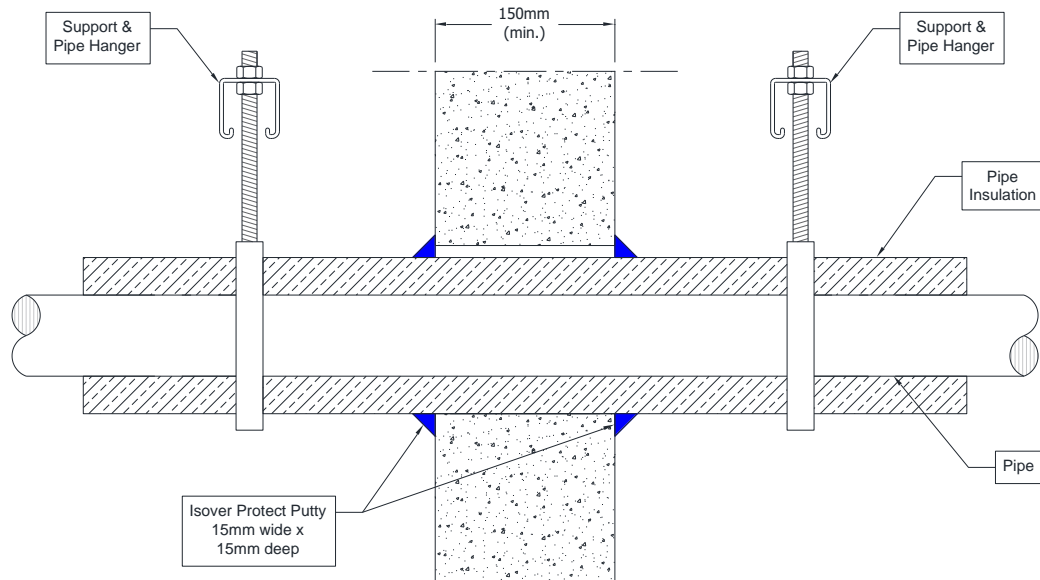


A.3.1.1


| Services | Insulation | Classification |
|---|----------------|-------------------|
| Mild or stainless steel pipe, with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 40 mm diameter* | 20 mm thick | EI 120 C/U |
| Maximum 324 mm diameter* | 30-80 mm thick | E 240, EI 180 C/U |
| Copper or steel pipe with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 54 mm diameter/1.2-14.2 mm wall | 20 mm thick | E 240, EI 120 C/C |
| ALUPEX pipe with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 16 mm diameter* | 20 mm thick | EI 240 C/C |
| Maximum 75 mm diameter* | 30 mm thick | EI 240 C/C |

*See below graphs for interpolation pipe sizes

Mild or Stainless Steel Pipes with 30 - 80 mm Thick Insulation - E 240, EI 180 C/U

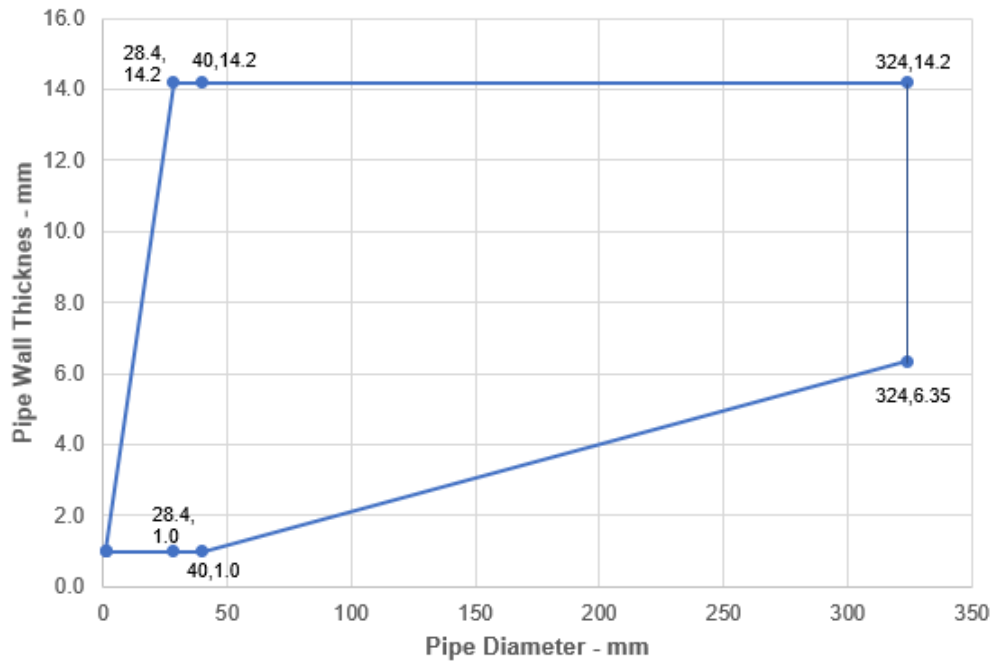

ALUPEX Pipes with 30 mm Thick Insulation - EI 240 C/C

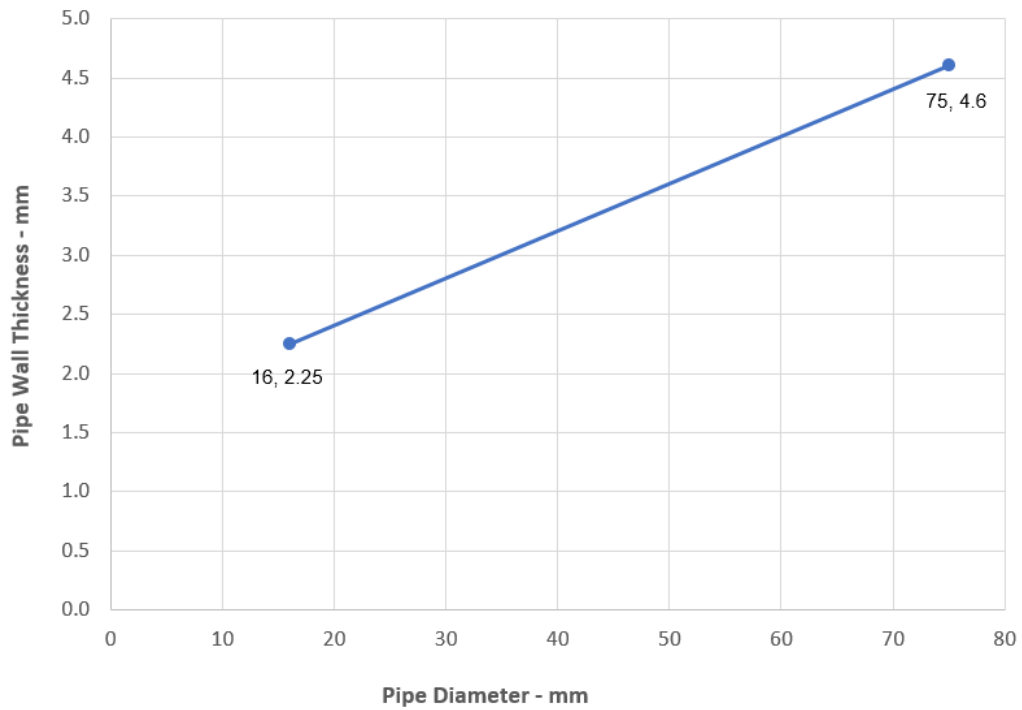


A.4 Rigid floor constructions with floor thickness of minimum 150 mm


A.4.1 Single sided penetration seal with cables

Penetration Seal: Cables (single or bundled up to 50 mm Ø) penetrating through a rigid floor construction and fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on the top face of the floor. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2). When incorporating blank penetration seals, the aperture is sealed with 15mm wide by 15mm thick cord of Isover Protect Putty, applied flush with the bottom face of the floor.

Construction details:

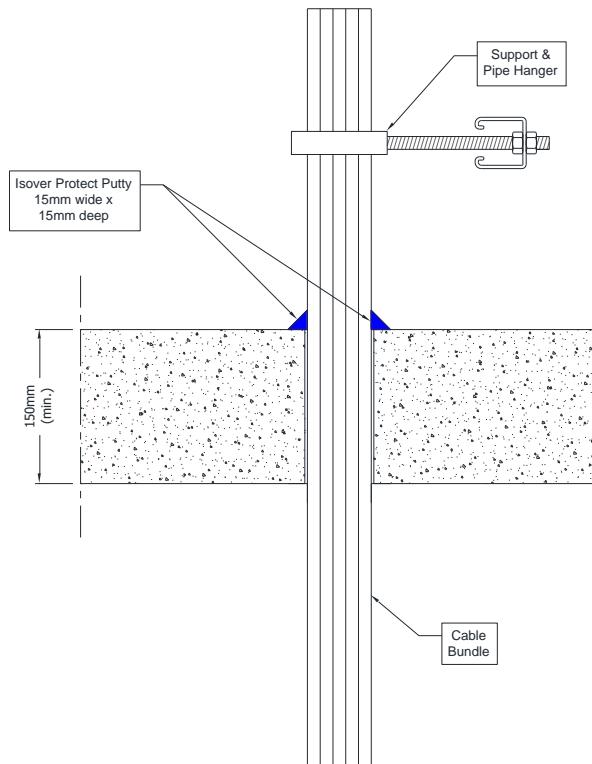

Construction details:

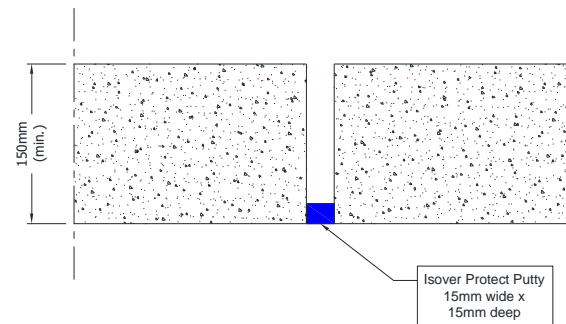

A.4.1.1


| Services | Classification |
|---|----------------|
| None (blank) | E 120, EI 30 |
| Cables up to 21 mm diameter in tied bundles up to 50 mm diameter* | E 120, EI 60 |
| Cables up to 21 mm diameter* | EI 120 |
| Cables 22-50 mm diameter* | E 120, EI 90 |
| Cables 51-80 mm diameter* | E 120, EI 60 |
| Single 'A1' type cable* | EI 240 |
| Single 'C3' type cable* | EI 240 |
| Single 'E' type cable* | EI 120 |
| Single 'D1' type cable* | EI 120 |
| Single 'D2' type cable* | EI 120 |
| Single 'D3' type cable* | E 240, EI 60 |

* Cable specification from EN 1366-3 standard cable configuration


A.4.2 Single sided penetration seal with cables

Penetration Seal: Cables (single or bundled up to 75 mm Ø) penetrating through a rigid floor construction and fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on the bottom face of the floor. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2). When incorporating blank penetration seals, the aperture is sealed with 15mm wide by 15mm thick cord of Isover Protect Putty, applied flush with both faces of the floor.

Construction details:

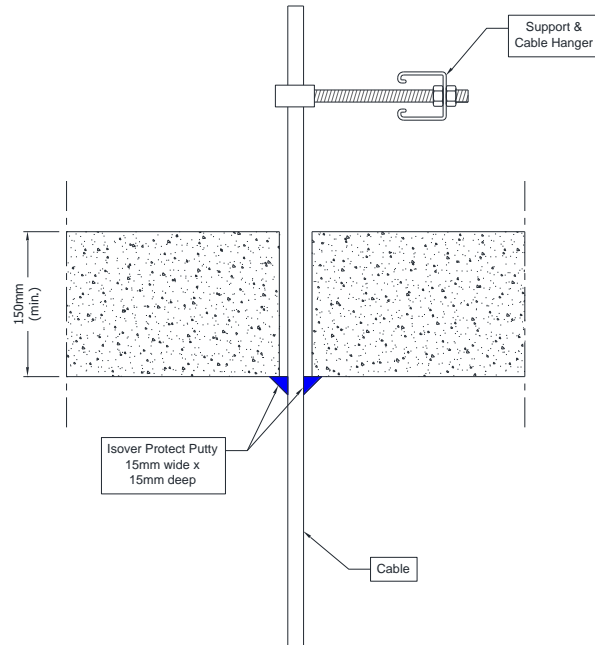

Construction details:

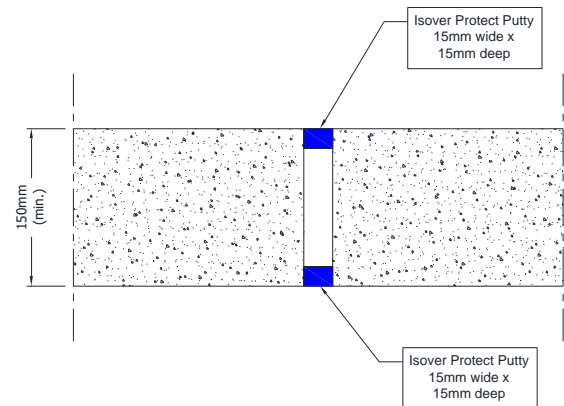

A.4.2.1


| Services | Seal size | Classification |
|--|---------------------|----------------|
| None (blank) | 15mm deep | EI 120 |
| Cables up to 21 mm diameter in tied bundles up to 75mm diameter* | 15 mm diameter cord | E 60, EI 45 |
| Cables up to 21 mm diameter* | | E 120, EI 60 |
| Cables 22-80 mm diameter* | | E 90, EI 45 |

* Cable specification from EN 1366-3 standard cable configuration

A.4.3 Double sided penetration seal with cables

Penetration Seal: Cables (single or bundled up to 50 mm Ø) penetrating through a rigid floor construction and fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on both sides of the floor. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

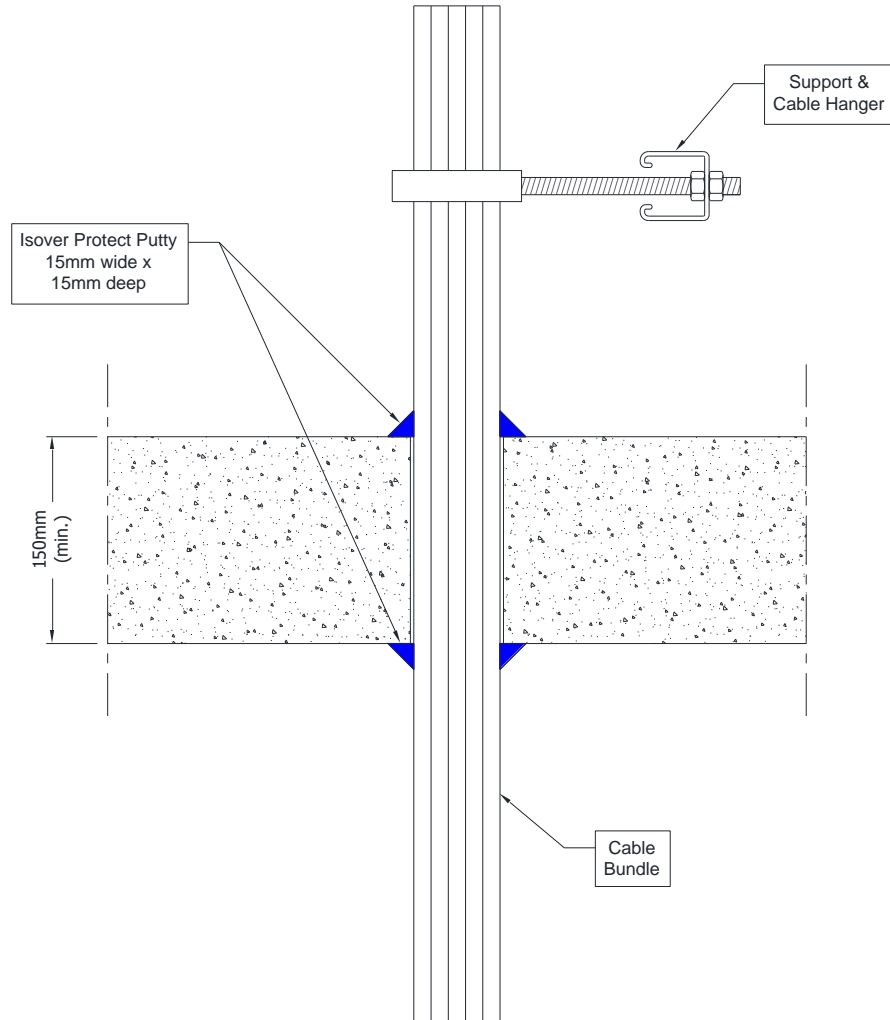

A.4.3.1


| Services | Seal size | Classification |
|---|---------------------|----------------|
| Cables up to 21 mm diameter in tied bundles up to 50 mm diameter* | 15 mm diameter cord | EI 240 |

* Cable specification from EN 1366-3 standard cable configuration

A.4.4 Single sided penetration seal with metallic pipes

Penetration Seal: Metallic pipes penetrating through a rigid floor construction and fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on the bottom face of the floor. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

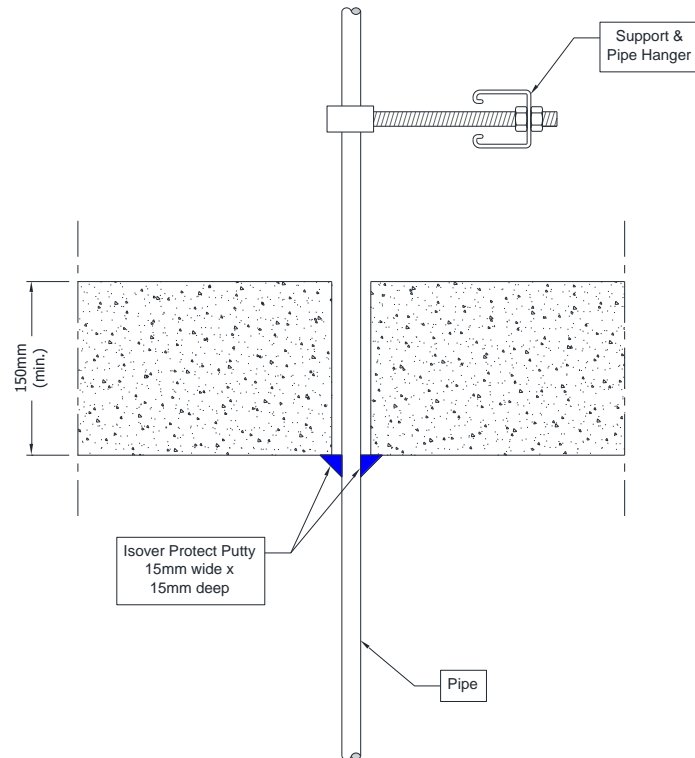


A.4.4.1


| Services | Insulation | Classification |
|------------------------------|-------------|------------------|
| Mild or stainless steel pipe | | |
| 4 mm diameter* | None needed | EI 120 C/U |
| 5-30 mm diameter* | None needed | E 120, EI 45 C/U |
| Copper or steel pipe | | |
| 6 mm diameter* | None needed | E 120, EI 90 C/C |
| 7-12 mm diameter* | None needed | E 120, EI 30 C/C |

*See below graphs for interpolation pipe sizes

Steel Pipes - E 120, EI 45 C/U

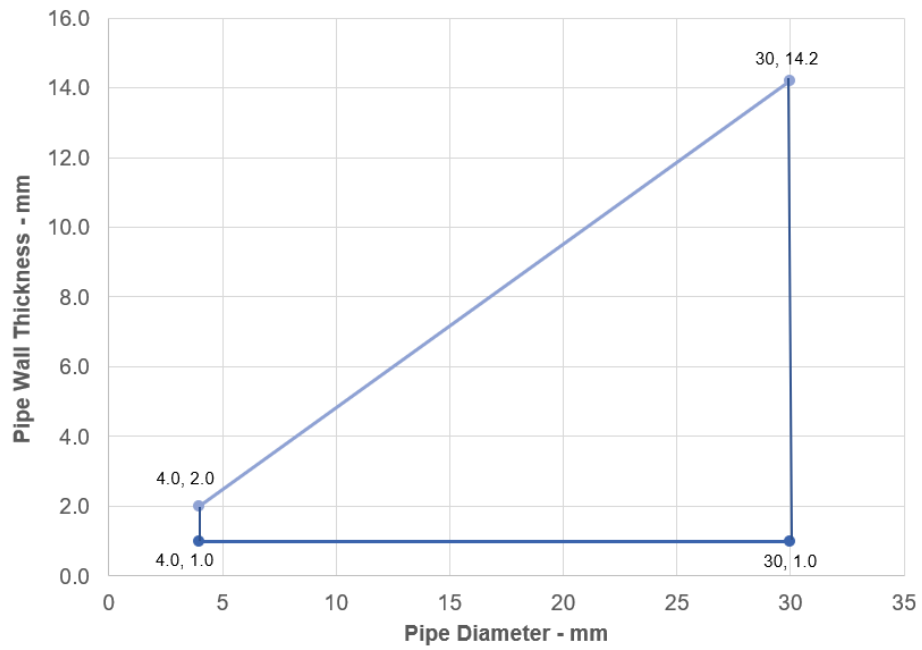


Copper Pipes - E 120, EI 30 C/C

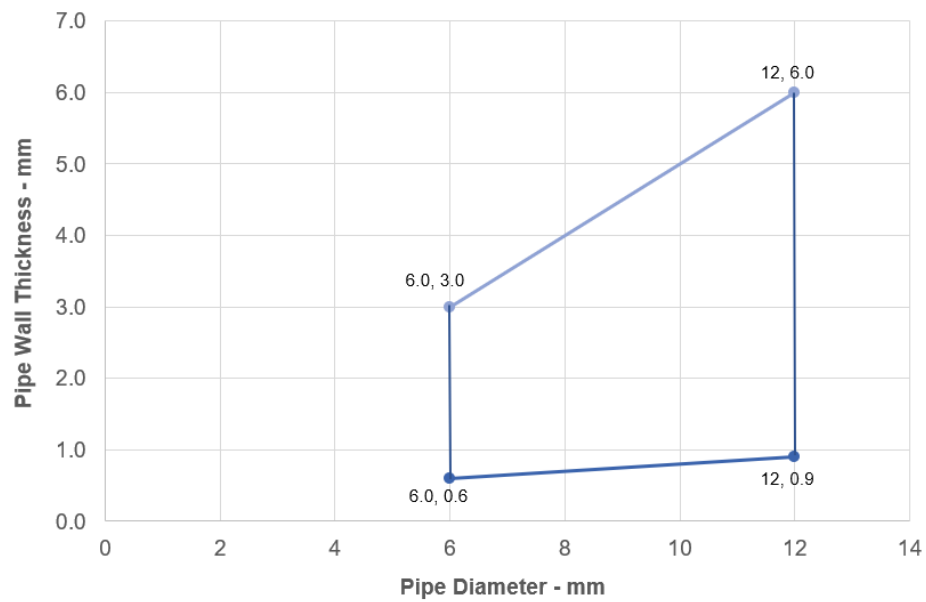

A.4.5 Single sided penetration seal with metallic pipes

Penetration Seal: Metallic pipes penetrating through a rigid floor construction and fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on the top face of the floor. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

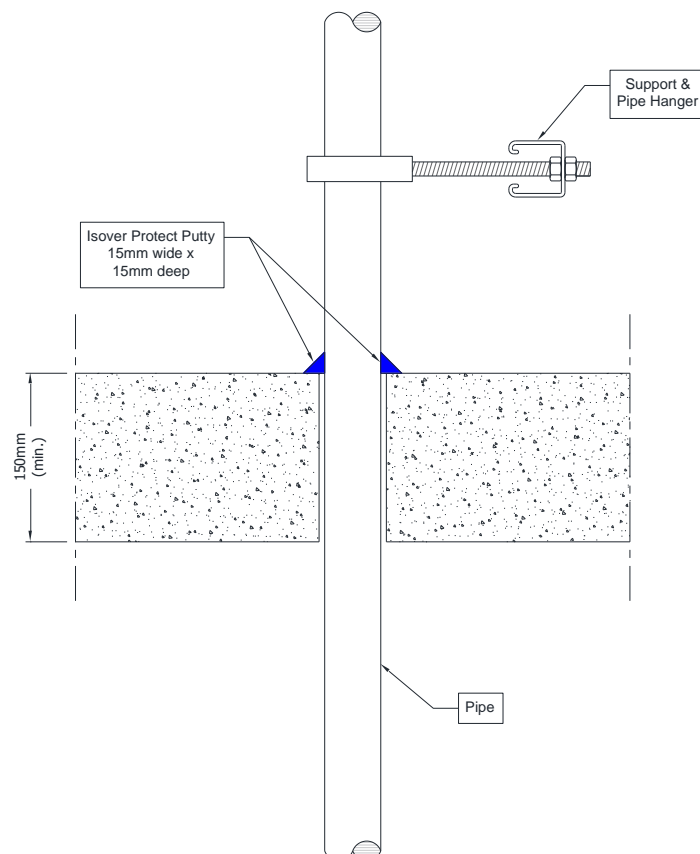


A.4.5.1


| Services | Insulation | Classification |
|--|-------------|------------------|
| Mild or stainless steel pipe | | |
| Maximum 22 mm diameter/1.2-11.0 mm wall* | None needed | EI 120 C/U |
| Maximum 324 mm diameter/6.35-14.2 mm wall* | None needed | E 240, EI 15 C/U |
| Copper or steel pipe | | |
| 6 mm diameter* | None needed | EI 120 C/C |
| 7-10 mm diameter* | None needed | E 120, EI 90 C/C |
| Maximum 54 mm diameter/1.2-14.2 mm wall | None needed | E 120 C/C |
| ALUPEX pipe | | |
| 16-20 mm diameter* | None needed | EI 240 C/C |
| Maximum 75 mm diameter/4.6-14.2 mm wall | None needed | E 45, EI 30 C/C |

*See below graphs for interpolation pipe sizes


Steel Pipes - E 120, EI 15 C/U

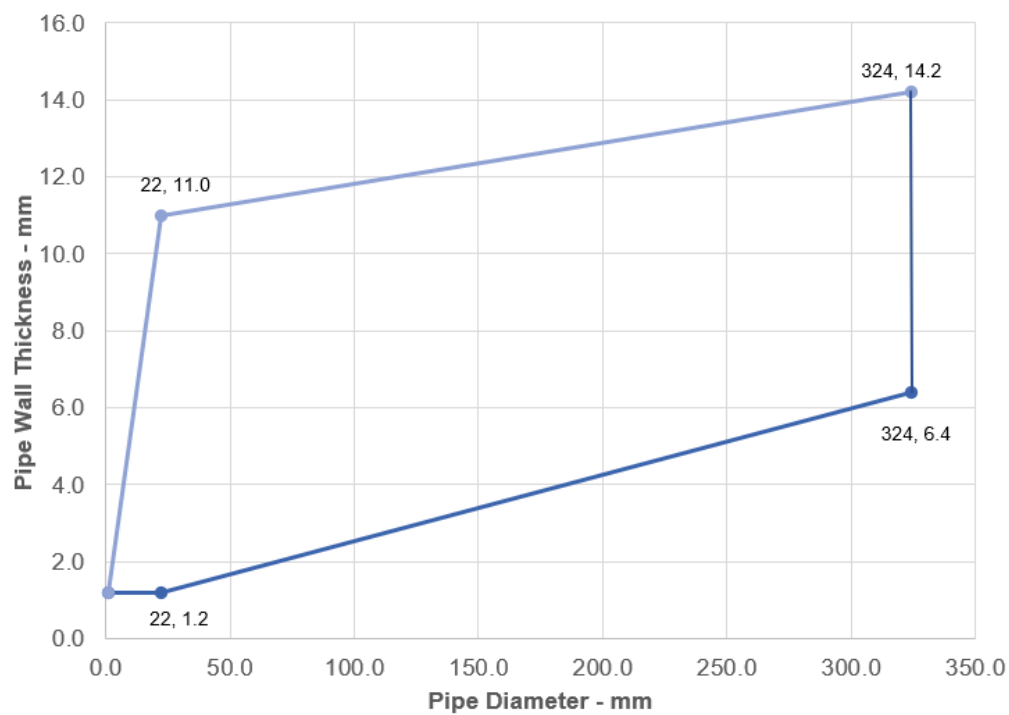

Copper or Steel Pipes - E 120, EI 90 C/C

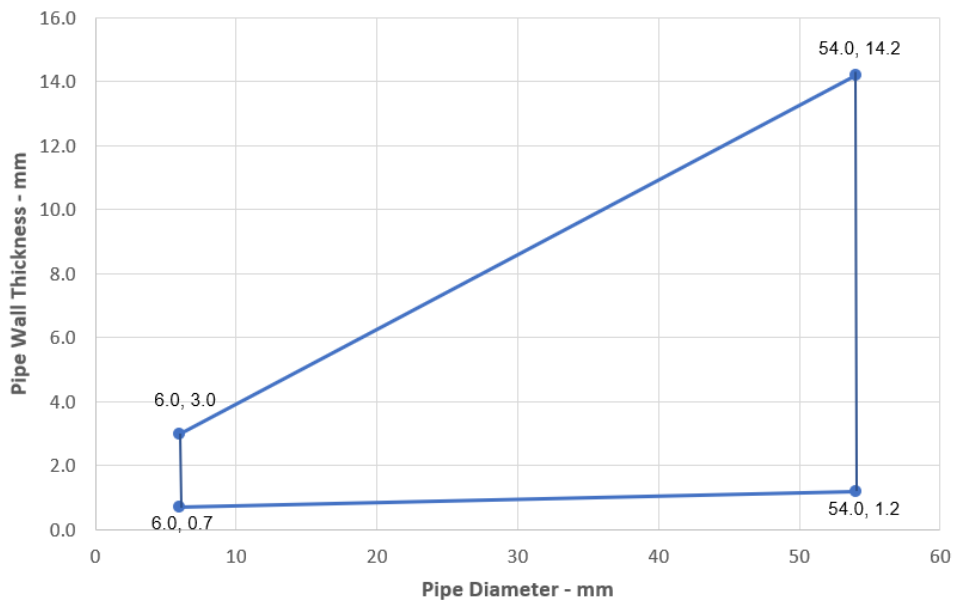


Alupex Pipes - EI 240 C/C

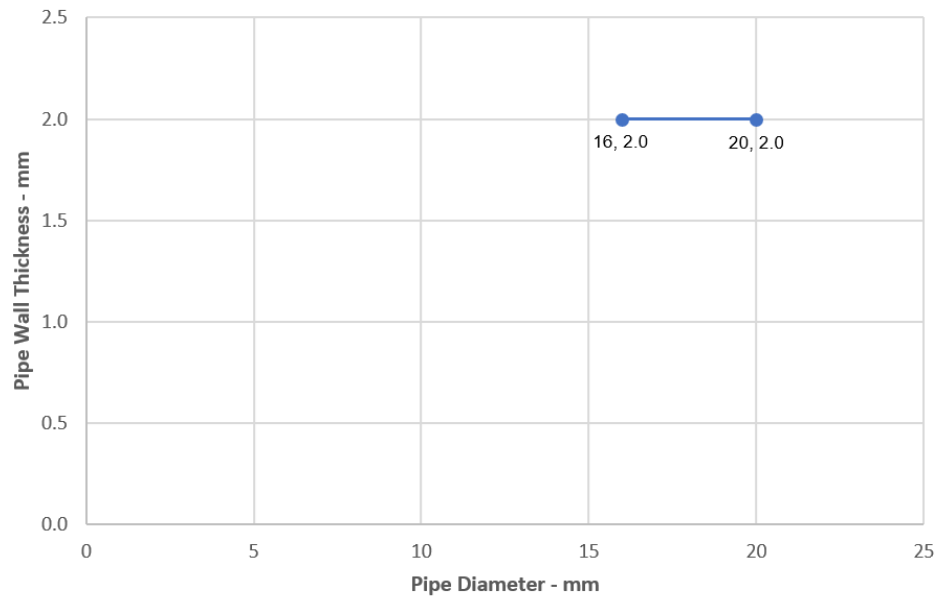

A.4.6 Double sided penetration seal with metallic pipes

Penetration Seal: Metallic pipes penetrating through a rigid floor construction and fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on both sides of the floor. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

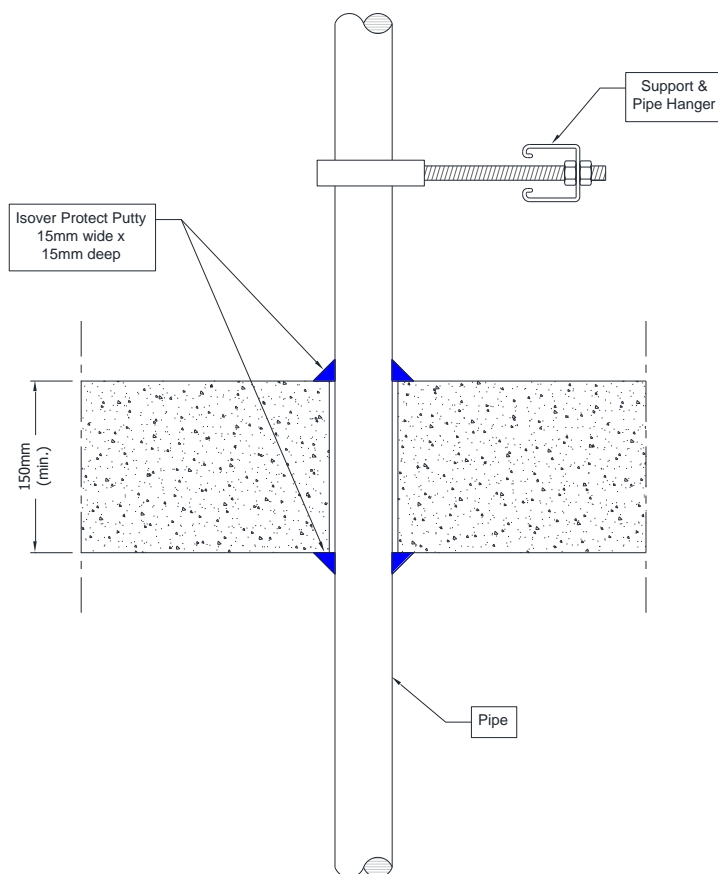


A.4.6.1

| Services | Insulation | Classification |
|---|-------------|-------------------|
| Copper or steel pipe | | |
| Maximum 10 mm diameter/0.7-14.2 mm wall | None needed | E 240, EI 180 C/C |

A.4.7 Single sided penetration seal with insulated metallic pipes, Local Interrupted (LI)

Penetration Seal: Metallic pipes insulated with minimum 80 kg/m³ density mineral wool insulation, Local Interrupted (LI), penetrating through a rigid floor construction, fitted at any position within the aperture, sealed with a 15 mm diameter cord of Isover Protect Putty on the top face of the floor. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

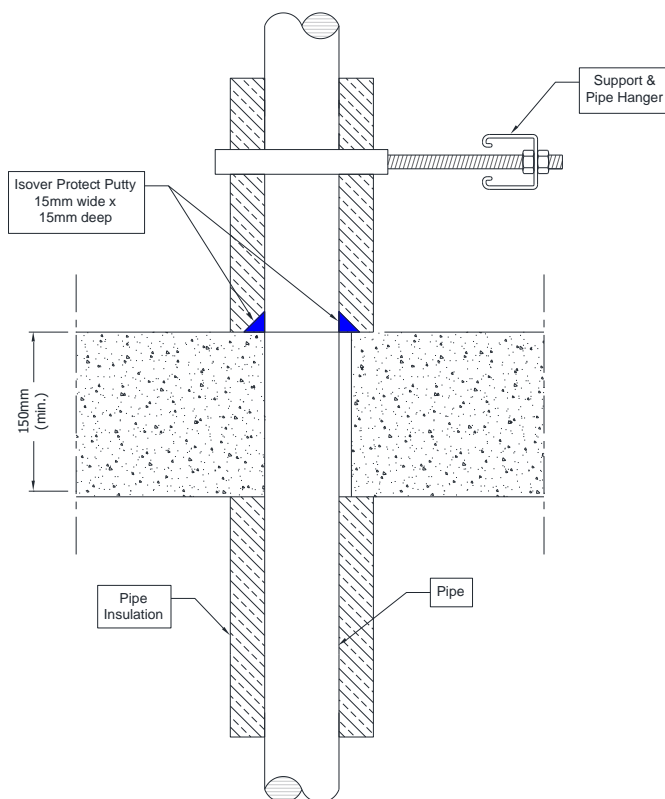


A.4.7.1 Single sided penetration seal with partially insulated metallic pipes


| Services | Insulation | Classification |
|---|---|------------------|
| Mild or stainless steel pipe, with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 40 mm diameter* | Minimum 20 mm thick insulation, 500 mm long butted up to each face of the floor | EI 240 C/U |
| 41-324 mm diameter* | Minimum 30 mm thick insulation, 500 mm long butted up to each face of the floor | E 240, EI 60 C/U |
| ALUPEX pipe with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 16 mm diameter/2.25-8.0 mm wall* | Minimum 20 mm thick insulation, 500 mm long butted up to each face of the floor | EI 240 C/C |
| Maximum 75 mm diameter/4.6-14.2 mm wall* | Minimum 30 mm thick insulation, 500 mm long butted up to each face of the floor | EI 240 C/C |

*See below graphs for interpolation pipe sizes

Steel Pipes with 30 mm Thick Insulation- E 240, EI 60 C/U

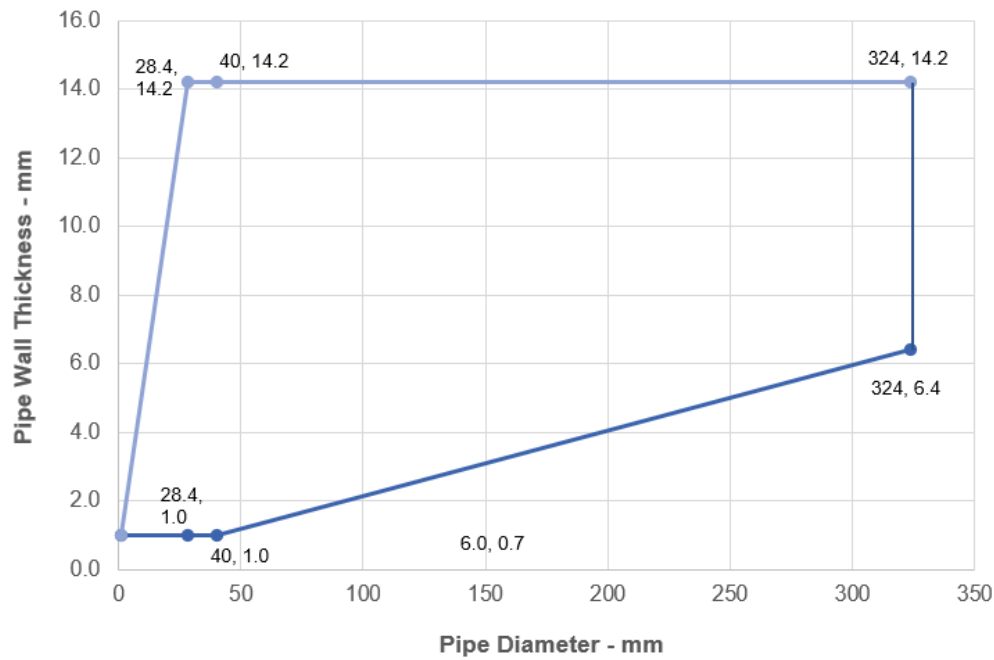


**Alupex Pipes with 30 mm Thick Pipe Insulation
EI 240 C/C**

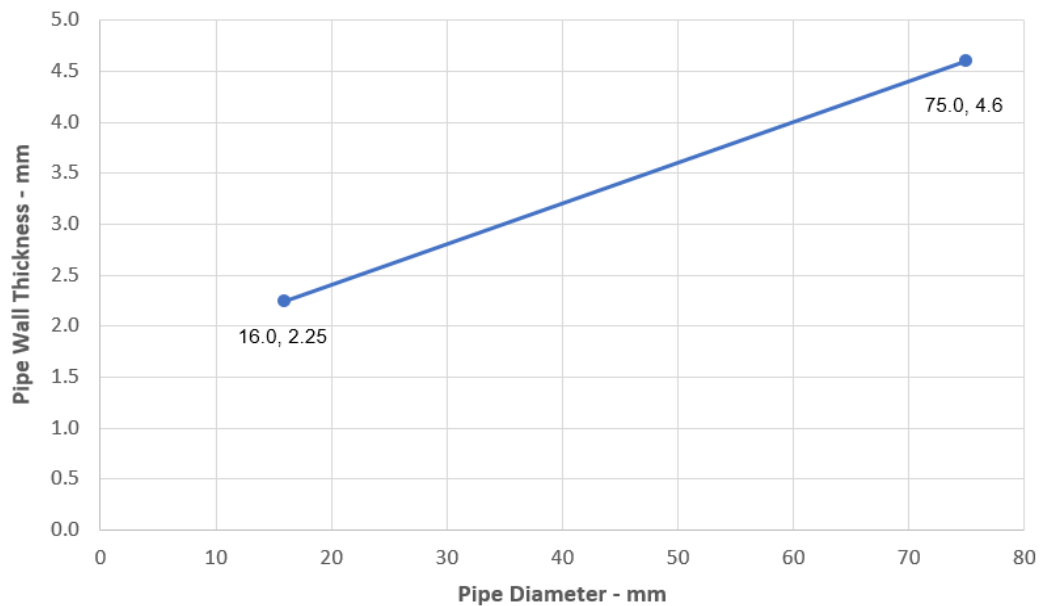

A.4.8 Single sided penetration seal with insulated metallic pipes, Local Interrupted (LI)

Penetration Seal: Metallic pipes insulated with minimum 75 kg/m³ density glass or mineral wool insulation, Local Interrupted (LI), penetrating through a rigid floor construction, fitted at any position within the aperture, sealed with a 15 mm diameter cord of Isover Protect Putty on the top face of the floor. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

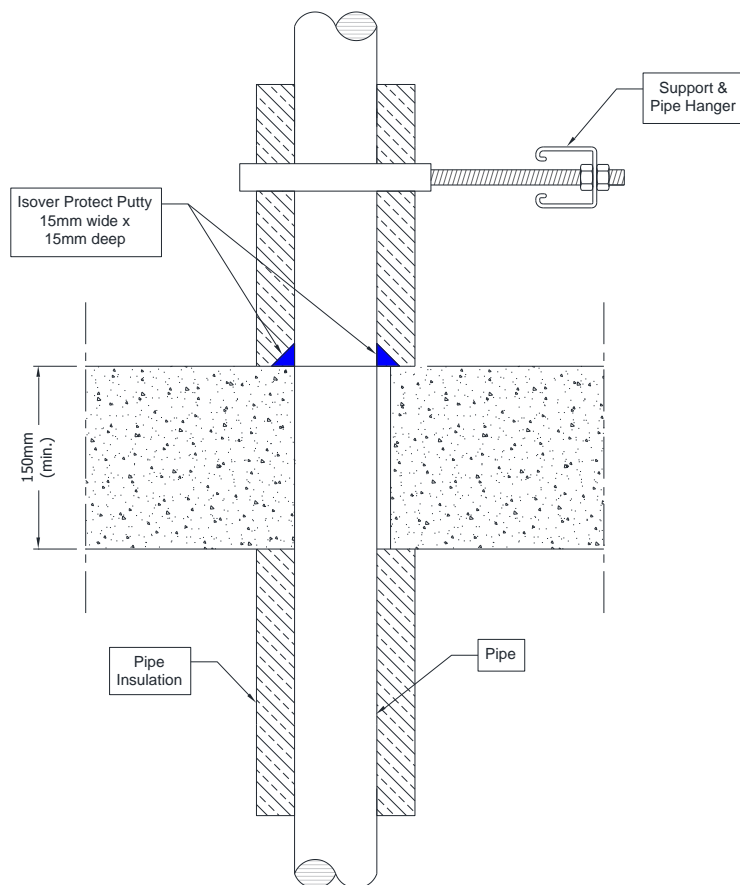


A.4.8.1

| Services | Insulation | Classification |
|---|---|-------------------|
| Steel pipe with minimum 75 kg/m ³ density glass or mineral wool insulation | | |
| Maximum 40 mm diameter/1.0-14.2 mm wall | Minimum 20 mm thick insulation, 500 mm long butted up to each face of the floor | EI 180 C/U |
| Copper or steel pipe with minimum 75 kg/m ³ density glass or mineral wool insulation | | |
| Maximum 12 mm diameter/0.7-14.2 mm wall* | Minimum 20 mm thick insulation, 500 mm long butted up to each face of the floor | EI 240 C/C |
| Maximum 54 mm diameter/1.2-14.2 mm wall* | | E 180, EI 120 C/C |

*See below graphs for interpolation pipe sizes


Copper Pipes- E 180, EI 120, C/C

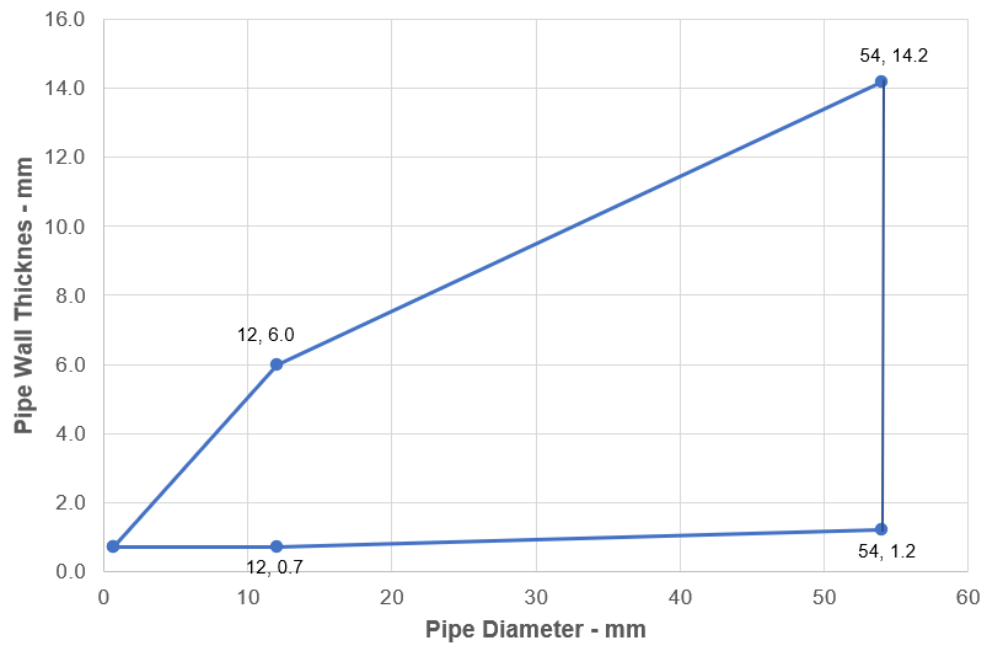

A.4.9 Single sided penetration seal with insulated metallic pipes, Continuous Sustained (CS)

Penetration Seal: Metallic pipes insulated with minimum 80 kg/m³ density mineral wool insulation, Continuous Sustained (CS), penetrating through a rigid floor construction, fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on the top face of the floor. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

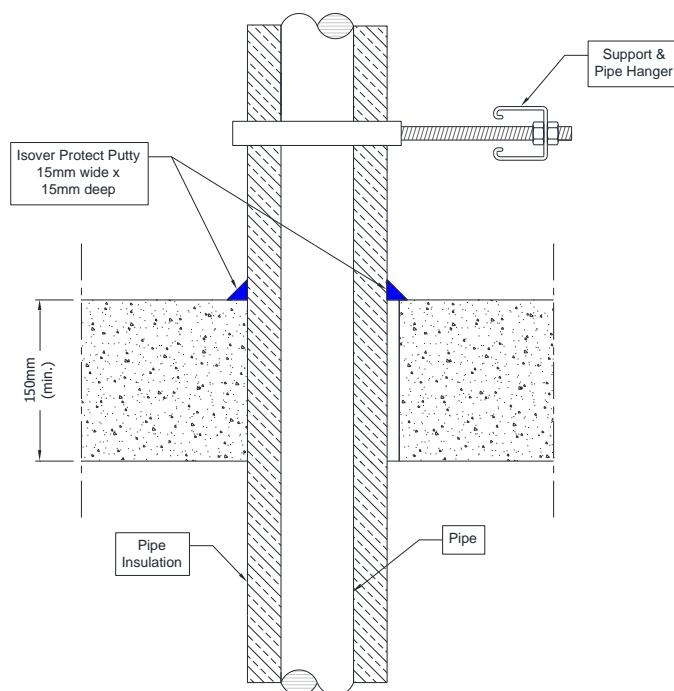


A.4.9.1


| Services | Insulation | Classification |
|---|---------------|----------------|
| Mild or stainless steel pipe, with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 40 mm diameter/1.0-14.2 mm wall | 20 mm thick | EI 240 C/U |
| Maximum 324 mm diameter* | 30-80mm thick | EI 240 C/U |
| Copper or steel pipe with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 12 mm diameter/0.7-6.0 mm wall* | 20 mm thick | EI 240 C/C |
| Maximum 54 mm diameter/1.2-14.2 mm wall* | 30-80mm thick | EI 240 C/C |
| ALUPEX pipe with minimum 80 kg/m ³ density mineral wool insulation | | |
| Maximum 16 mm diameter/2.25-8.0 mm wall* | 20 mm thick | EI 240 C/C |
| Maximum 75 mm diameter/4.6-14.2 mm wall* | 30-80mm thick | EI 240 C/C |

*See below graphs for interpolation pipe sizes


Steel Pipes with 30-80 mm Thick Insulation - EI 240, C/U

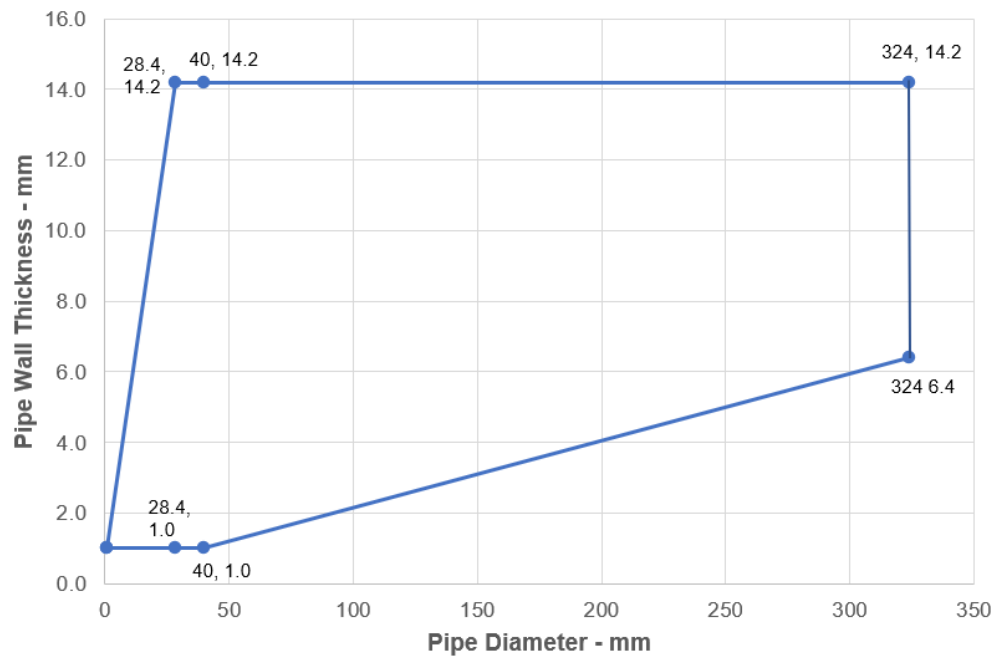

Copper or Steel Pipes with 30-80 mm Thick Insulation - EI 240, C/C

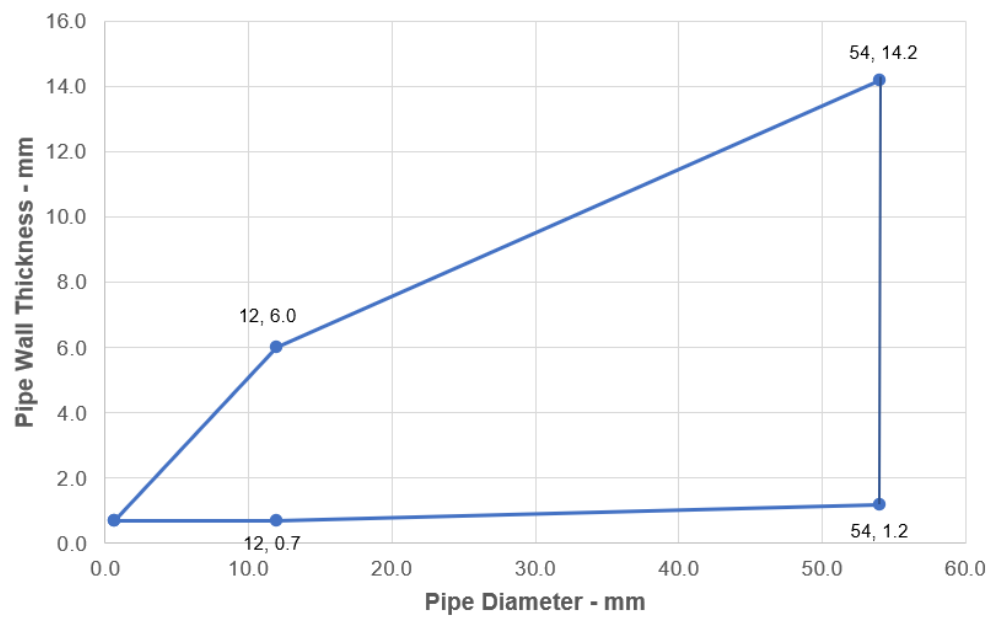


**Alupex Pipes with 30-80 mm Thick Insulation
EI 240 C/C**

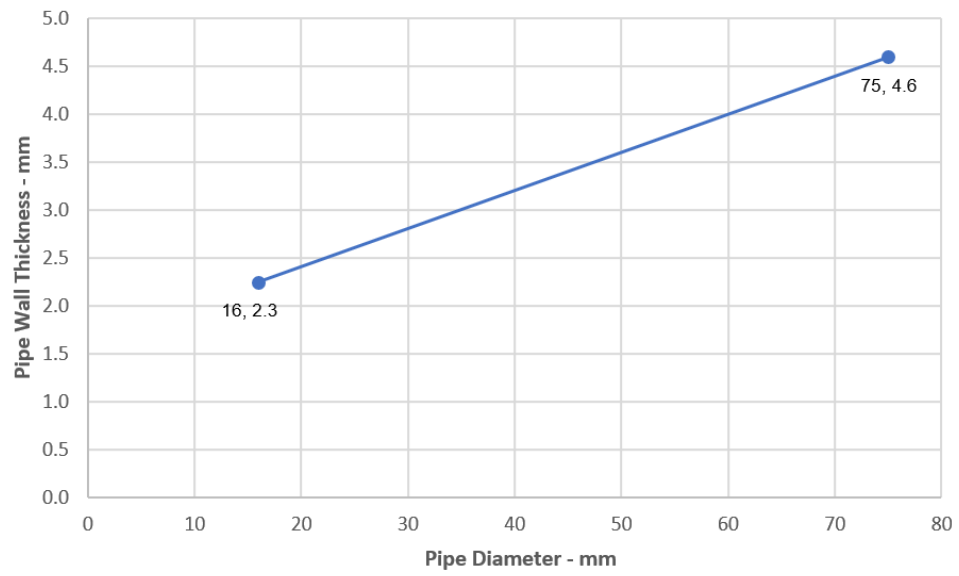

A.4.10 Single sided penetration seal with insulated metallic pipes, Continuous Sustained (CS)

Penetration Seal: Metallic pipes insulated with minimum 75 kg/m³ density glass wool insulation, Continuous Sustained (CS), penetrating through a rigid floor construction, fitted at any position within the aperture, sealed with a 15mm diameter cord of Isover Protect Putty on the top face of the floor. Maximum annular space 10 mm (a1) and minimum separation between penetration seals 30 mm (a2).

Construction details:

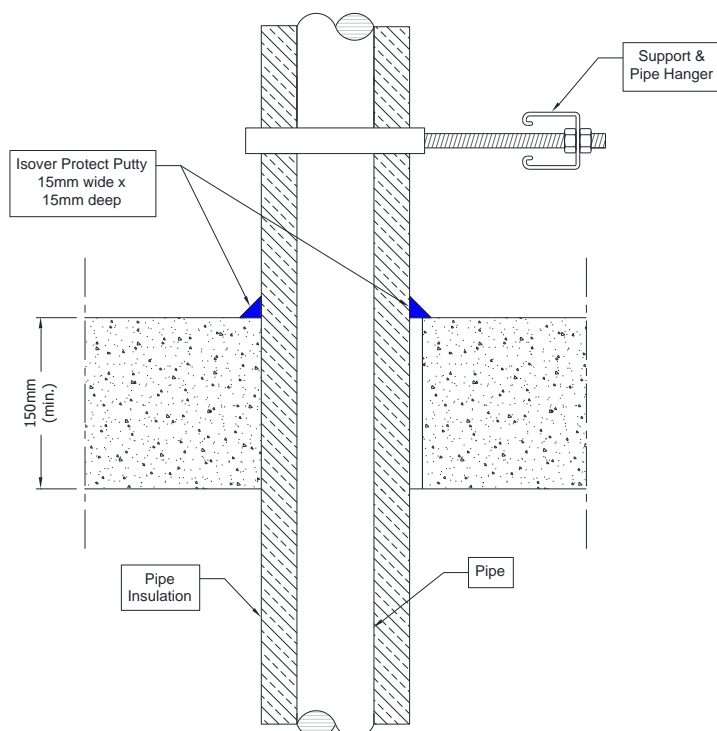


A.4.10.1


| Services | Insulation | Classification |
|--|---------------|-----------------------------|
| Steel pipe with minimum 75 kg/m ³ density glass wool insulation | | |
| Maximum 40 mm diameter/1.0-14.2 mm wall* | 20 mm thick | E 180 EI 120 C/U |
| Copper or steel pipe with minimum 75 kg/m ³ density glass wool insulation | | |
| Maximum 12 mm diameter/0.7-6.0 mm wall* | 20 mm thick | E 240, EI 90 C/C |
| Maximum 54 mm diameter/1.2-14.2 mm wall* | 20-40mm thick | EI 90 C/C |
| ALUPEX pipe with minimum 75 kg/m ³ density glass wool insulation | | |
| Maximum 16 mm diameter/2.25-8.0 mm wall* | 20 mm thick | EI 120 C/C |
| Maximum 75 mm diameter/4.6-14.2 mm wall* | 20-50mm thick | EI 120 C/C |

*See below graphs for interpolation pipe sizes

Copper or Steel Pipes - EI 90, C/C

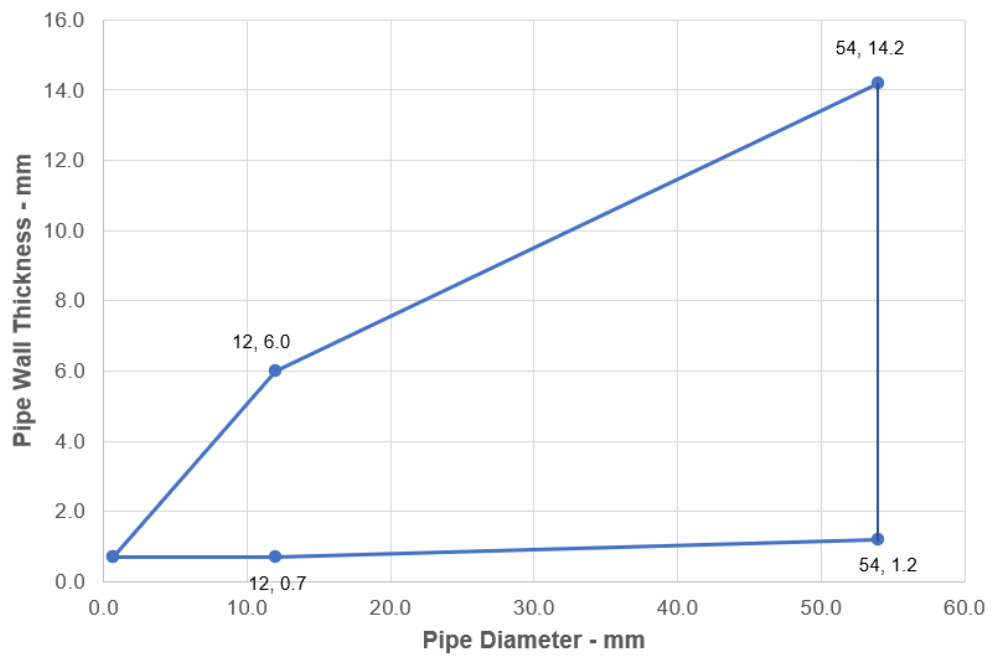

Alupex Pipes - EI 120 C/C

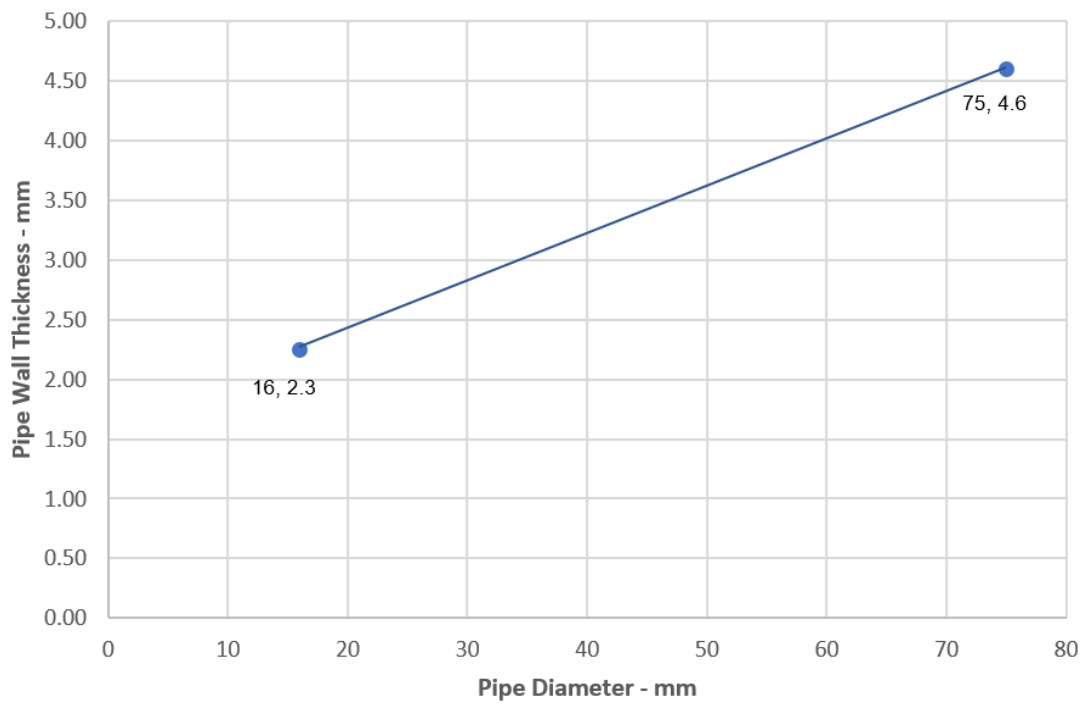

ANNEX B – Air Permeability – Isover Protect Putty

| Product tested | Isover Protect Putty Cord around 48mm electrical cable in 58mm hole | | |
|---|---|-----------------------------|---|
| Summary of testing procedure | | | Result |
| | Pressure (Pa) | Leakage (m ³ /h) | Leakage (m ³ /m ² /h) |
| Results under negative chamber pressure | 25 | 0.32 | N/A |
| | 50 | 0.60 | N/A |
| | 100 | 1.00 | N/A |
| | 200 | 1.63 | N/A |
| | 300 | 2.26 | N/A |
| | 600 | 2.64 | N/A |
| | 1000 | 3.25 | N/A |
| Results under positive chamber pressure | 25 | 0.24 | N/A |
| | 50 | 0.26 | N/A |
| | 100 | 0.36 | N/A |
| | 200 | 0.56 | N/A |
| | 300 | 1.11 | N/A |
| | 600 | 1.88 | N/A |
| | 1000 | 2.49 | N/A |

